DATASHEET - DILAC-31(110V50HZ,120V60HZ)



Contactor relay, 110 V 50 Hz, 120 V 60 Hz, 3 N/O, 1 NC, Spring-loaded terminals, AC operation $\,$



Part no. DILAC-31(110V50HZ,120V60HZ)

Catalog No. 276470

Alternate Catalog XTREC10B31A

No.

EL-Nummer 4110164

(Norway)

Similar to illustration

Delivery program

| Delivery program | | | |
|---|----------------|---|---|
| Product range | | | DILA relays |
| Application | | | Contactor relays |
| Description | | | Basic devices with positive operation contacts |
| Connection technique | | | Spring-loaded terminals |
| Rated operational current | | | |
| AC-15 | | | |
| 220 V 230 V 240 V | I _e | Α | 4 |
| 380 V 400 V 415 V | l _e | Α | 4 |
| Contacts | | | |
| N/O = Normally open | | | 3 N/O |
| N/C = Normally closed | | | 1 NC |
| Contact sequence | | | A1 13 21 33 43 44 A2 14 22 34 44 |
| Instructions | | | Contact numbers to EN 50011 Coil terminal markings to EN 50005 |
| Code number and version of combination | | | |
| Distinctive number | | | 31E |
| Can be combined with auxiliary contact module | | | DILA-XHIC(V) |
| Actuating voltage | | | 110 V 50 Hz, 120 V 60 Hz |
| Voltage AC/DC | | | AC operation |
| Connection to SmartWire-DT | | | no |
| Instructions | | | Contact numbers to EN 50011 Coil terminal markings to EN 50005 |

Technical data

| General | | | |
|------------------------------|--------------|-------------------|--|
| Standards | | | IEC/EN 60947, EN 60947-5-1, VDE 0660, UL, CSA |
| Lifespan, mechanical | | | |
| AC operated | Operations | x 10 ⁶ | 20 |
| Maximum operating frequency | Operations/h | | 9000 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Open | | °C | -25 - +60 |
| Enclosed | | °C | - 25 - 40 |
| Ambient temperature, storage | | °C | - 40 - 80 |
| Mounting position | | | |
| Mounting position | | | |

| | g | |
|--|---|--|
| | g | |
| | J | |
| | g | 7 |
| | g | 5 |
| | | IP20 |
| | | Finger and back-of-hand proof |
| | m | Max. 2000 |
| | | |
| | kg | 0.24 |
| | mm ² | |
| | | |
| | mm ² | 1 x (0.75 - 2.5) |
| | | 2 x (0.75 - 2.5) |
| | mm^2 | 1 x (0,75 - 1.5) 2 x (0,75 - 1.5) |
| | ΔWG | 18 - 14 |
| | | 10 |
| | | 0.6 x 3.5 |
| | | |
| | | Yes |
| U _{imp} | V AC | 6000 |
| | | III/3 |
| Ui | V AC | 690 |
| U _e | V AC | 690 |
| | | |
| | V AC | 400 |
| | V AC | 400 |
| | Α | |
| | | |
| | | |
| I _{th} =I _e | Α | 16 |
| | | |
| I _e | Α | 4 |
| I _e | Α | 4 |
| | Α | 1.5 |
| , and the second | | |
| | | Switch-on and switch-off conditions based on DC-13, time constant as specified. |
| | | |
| | A | |
| 24 V | Α | 10 |
| 60 V | A | 6 |
| 60 V | A | 10 |
| 110 V | A | 3 |
| 110 V | Α | 6 |
| 220 V | Α | 1 |
| 220 V | Α | 5 |
| | | |
| | Α | |
| 24 V | Α | 4 |
| 60 V | Α | 4 |
| 110 V | Α | 2 |
| 220 V | Α | 1 |
| Failure rate | λ | <10 ⁻⁸ , < one failure at 100 million operations |
| | | (at $U_e = 24 \text{ V DC}$, $U_{min} = 17 \text{ V}$, $I_{min} = 5.4 \text{ mA}$) |
| | U _i U _e I _{th} = I _e I _e I _e I _e I ₁₀ V 110 V 110 V 220 V 220 V 220 V | kg mm² mm² mm² mm² mm² mm mm |

| Maximum overcurrent protective device | | | |
|--|---------|------------------|-----------|
| 220 V 230 V 240 V | | PKZM0 | 4 |
| 380 V 400 V 415 V | | PKZM0 | 4 |
| Short-circuit protection maximum fuse | | | |
| 500 V | | A gG/gL | 10 |
| Current heat loss at I _{th} | | | |
| AC operated | | W | 0.53 |
| Magnet systems | | | |
| Voltage tolerance | | | |
| AC operated | | | |
| Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz | Pick-up | x U _c | 0.8 - 1.1 |
| Power consumption | | | |
| AC operation | | | |
| Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz | Pick-up | VA | 24 |
| Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz | Sealing | VA | 3.4 |
| Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz | Sealing | W | 1.4 |
| duty factor | | % DF | 100 |
| Changeover time at 100 $\%$ $\rm U_{S}$ (recommended value) | | | |
| AC operated closing delay | | ms | 15 - 21 |
| AC operated N/O contact opening delay | | ms | 9 - 18 |
| Rating data for approved types | | | |
| Auxiliary contacts | | | |
| Pilot Duty | | | |
| AC operated | | | A600 |
| DC operated | | | P300 |
| General Use | | | |
| AC | | V | 600 |
| AC | | Α | 15 |
| DC | | V | 250 |
| | | | |

Design verification as per IEC/EN 61439

DC

| Design vernication as per 1EG/EN 01433 | | | |
|--|-------------------|----|--|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | In | Α | 15.5 |
| Heat dissipation per pole, current-dependent | P _{vid} | W | 0.5 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 0 |
| Static heat dissipation, non-current-dependent | P_{vs} | W | 1.4 |
| Heat dissipation capacity | P _{diss} | W | 0 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 60 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |


| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
|--|--|
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 7.0


| Low-voltage industrial components (EG000017) / Contactor relay (EC000196) | | | |
|---|---|-------------------------|--|
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Contactor relay (ecl@ss10.0.1-27-37-10-01 [AAB716014]) | | | |
| Rated control supply voltage Us at AC 50HZ | V | 110 - 110 | |
| Rated control supply voltage Us at AC 60HZ | V | 120 - 120 | |
| Rated control supply voltage Us at DC | V | 0 - 0 | |
| Voltage type for actuating | | AC | |
| Rated operation current le, 400 V | А | 4 | |
| Connection type auxiliary circuit | | Spring clamp connection | |
| Mounting method | | DIN-rail/screw | |
| Interface | | No | |
| Number of auxiliary contacts as normally closed contact | | 1 | |
| Number of auxiliary contacts as normally open contact | | 3 | |
| Number of auxiliary contacts as normally closed contact, delayed switching | | 0 | |
| Number of auxiliary contacts as normally open contact, leading | | 0 | |
| With LED indication | | No | |
| Number of auxiliary contacts as change-over contact | | 0 | |
| Manual operation possible | | No | |


Approvals

| Product Standards | IEC/EN 60947-4-1; UL 508; CSA-C22.2 No. 14-05; CE marking |
|--------------------------------------|---|
| UL File No. | E29184 |
| UL Category Control No. | NKCR |
| CSA File No. | 012528 |
| CSA Class No. | 3211-03 |
| North America Certification | UL listed, CSA certified |
| Specially designed for North America | No |

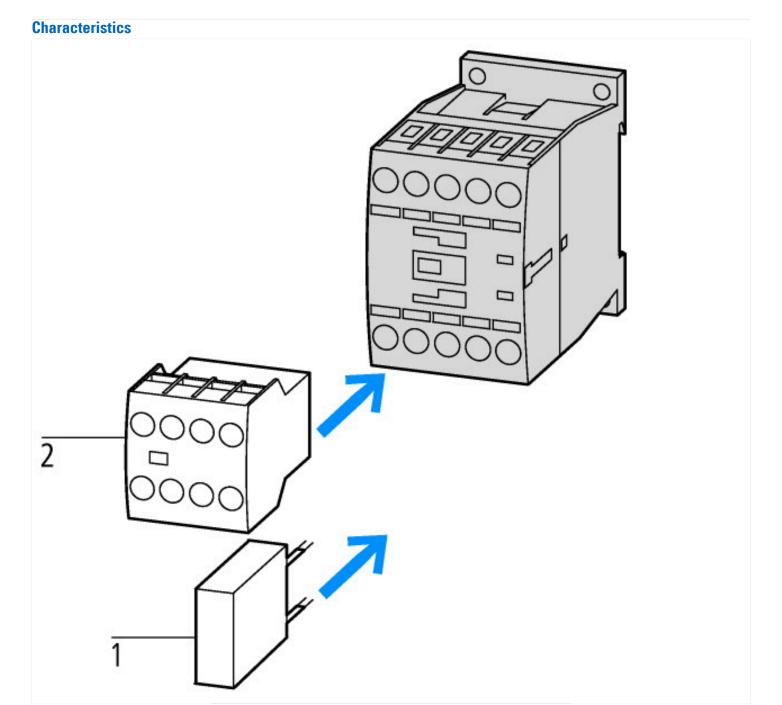

1: Suppressor 2: Auxiliary contact module

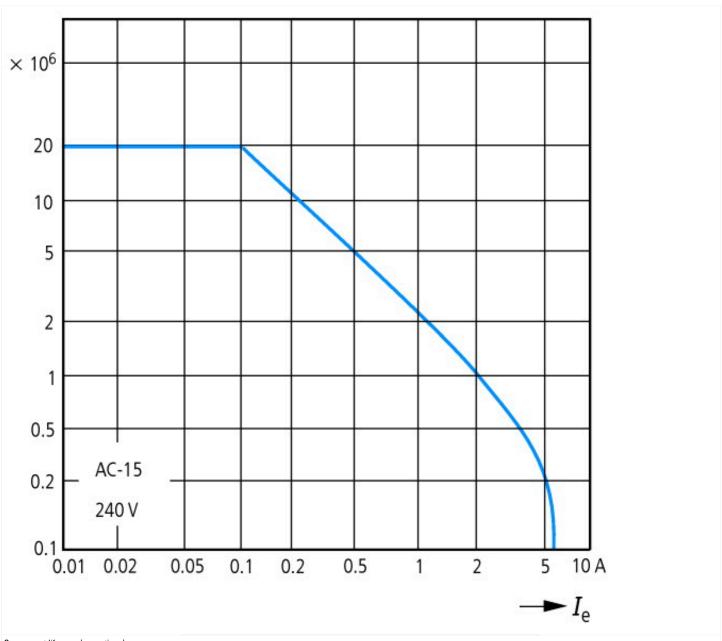

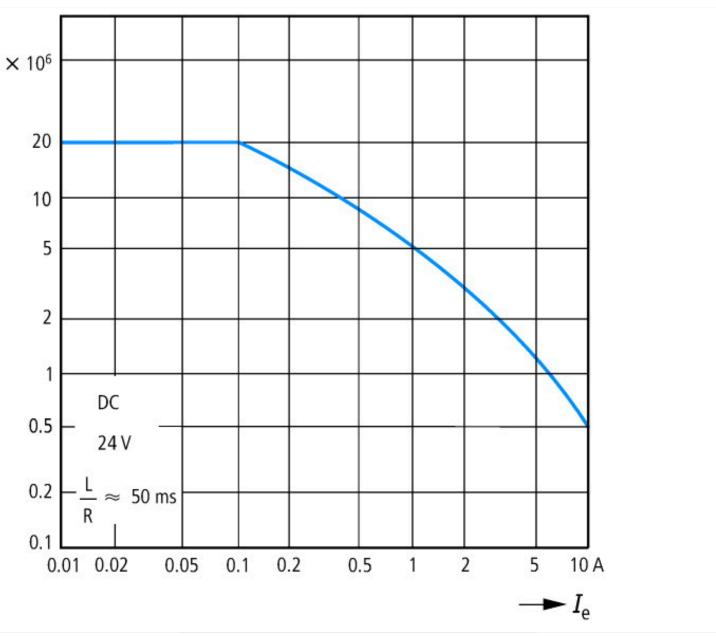

Component lifespan (operations) I_e = rated operational current

Three contacts in series

Dimensions

