## **DATASHEET - NZMH2-M20**



Circuit-breaker, 3p, 20A

Part no. NZMH2-M20 Catalog No. 281299



Similar to illustration

#### **Delivery program**

Delivery program			
Product range			Circuit-breaker
Protective function			Motor protection
			IE3 ✓
Standard/Approval			IEC
Installation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM2
Description			Tripping class 10 A IEC/EN 60947-4-1, IEC/EN 60947-2
			The circuit-breaker fulfills all requirements for AC-3 switching category.
Number of poles			3 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I <sub>cu</sub>	kA	150
Rated current = rated uninterrupted current	$I_n = I_u$	Α	20
Setting range			
Overload trip			
4	I <sub>r</sub>	A	16 - 20
Short-circuit releases			
Non-delayed	$I_i = I_n \times \dots$		350 A fixed
Motor rating AC-3 50/60 Hz			
380 V 400 V	Р	kW	7.5
Motor rating AC-3 50/60 Hz			
400 V	Р	kW	7.5
Rated operational current AC-3 50/60 Hz			
400 V	I <sub>e</sub>	Α	16

## **Technical data**

#### General

delleral		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70

Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27		g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts		V AC	500
between the auxiliary contacts		V AC	300
Mounting position			Vertical and 90° in all directions  With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	20
Rated surge voltage invariability	U <sub>imp</sub>		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	U <sub>e</sub>	V AC	690
Overvoltage category/pollution degree			III/3
Rated insulation voltage	Ui	V	1000
Use in unearthed supply systems		V	≦ 690
Switching capacity			
Rated short-circuit making capacity	I <sub>cm</sub>		
240 V	I <sub>cm</sub>	kA	330
400/415 V	I <sub>cm</sub>	kA	330
440 V 50/60 Hz	I <sub>cm</sub>	kA	286
525 V 50/60 Hz	I <sub>cm</sub>	kA	105
690 V 50/60 H	Ic	kA	40
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>		
Icu to IEC/EN 60947 test cycle 0-t-C0	Icu	kA	
240 V 50/60 Hz	I <sub>cu</sub>	kA	150
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	150
440 V 50/60 Hz	I <sub>cu</sub>	kA	130
525 V 50/60 Hz	I <sub>cu</sub>	kA	50
690 V 50/60 Hz	I <sub>cu</sub>	kA	20
Ics to IEC/EN 60947 test cycle O-t-CO-t-CO	Ics	kA	
240 V 50/60 Hz	I <sub>cs</sub>	kA	150
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	150
440 V 50/60 Hz	I <sub>cs</sub>	kA	130
525 V 50/60 Hz	I <sub>cs</sub>	kA	37.5
690 V 50/60 Hz	I <sub>cs</sub>	kA	5
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current			
t = 0.3 s	I <sub>cw</sub>	kA	1.9
t = 0.0 S	·CVV		110

Dilization category to IEC/EN 80947-2   Lifespan, mechanical (of which max. 50 % trip by shunt/undervoltage release)   Diffespan, electrical     AC-1	
Lifespan, electrical       AC-1         AC-1       00 V 50/60 Hz       Operations       10000         415 V 50/60 Hz       Operations       7500         690 V 50/60 Hz       Operations       6500         400 V 50/60 Hz       Operations       6500         415 V 50/60 Hz       Operations       6500         690 V 50/60 Hz       Operations       5000         Max. operating frequency       Operations       > 5000         Total break time at short-circuit       ms       < 10	
AC-1 400 V 50/60 Hz 0 Operations 10000  415 V 50/60 Hz 0 Operations 7500  AC-3 400 V 50/60 Hz 0 Operations 7500  AC-3 400 V 50/60 Hz 0 Operations 6500 6500 6500 6500 6500 6500 6500 650	
400 V 50/60 Hz   Coperations   10000	
A15 V 50/60 Hz	
AC3	
AC3  400 V 50/60 Hz  415 V 50/60 Hz  690 V 50/60 Hz  690 V 50/60 Hz  Max. operations  6500  Operations  Total break time at short-circuit  ms  <10  Terminal capacity  Standard equipment  Optional accessories  Optio	
400 V 50/60 Hz	
415 \to 50/60 \to 12	
G90 V 50/60 Hz	
Max. operating frequency Total break time at short-circuit  Terminal capacity Standard equipment Optional accessories Solid Solid Solid Stranded Stranded Solid Solid Solid Stranded Solid	
Total break time at short-circuit  Terminal capacity  Standard equipment  Optional accessories  Screw connection  Box terminal Tunnel terminal Connection on rear  Solid  mm² 1 x (10 - 16) 2 x (6 - 16)  Stranded  mm² 1 x (25 - 185) 2 x (25 - 70)  Tunnel terminal  Solid  mm² 1 x 16  Stranded  mm² 1 x 16	
Terminal capacity Standard equipment Optional accessories Screw connection Optional accessories Solud copper conductor  Box terminal Solid mm² 1 x (10 - 16) 2 x (6 - 16)  Stranded mm² 1 x (25 - 185) 2 x (25 - 70)  Tunnel terminal Solid mm² 1 x 16  Stranded mm² 1 x 16	
Standard equipment       Screw connection         Optional accessories       Box terminal Tunnel terminal connection on rear         Round copper conductor       To see the connection on rear         Box terminal       To see the connection on rear         Solid       mm²       1 x (10 - 16) 2 x (6 - 16)         2 x (6 - 16)       2 x (6 - 16)       2 x (25 - 185) 2 x (25 - 70)         Tunnel terminal       mm²       1 x 16         Stranded       mm²       1 x 16         1-hole       mm²       1 x (25 - 185)	
Tunnel terminal connection on rear	
Box terminal       mm²       1 x (10 - 16) 2 x (6 - 16)         Stranded       mm²       1 x (25 - 185) 2 x (25 - 70)         Tunnel terminal       mm²       1 x 16         Stranded       mm²       1 x (25 - 185)         1-hole       mm²       1 x (25 - 185)	
Solid       mm²       1 x (10 - 16) 2 x (6 - 16)         Stranded       mm²       1 x (25 - 185) 2 x (25 - 70)         Tunnel terminal       Solid       mm²       1 x 16         Stranded       1 -hole       mm²       1 x (25 - 185)	
Stranded   2 x (6 - 16)	
Tunnel terminal   2 x (25 - 70)	
Solid       mm²       1 x 16         Stranded       1-hole       mm²       1 x (25 - 185)	
Stranded  1-hole	
1-hole mm <sup>2</sup> 1 x (25 - 185)	
Bolt terminal and rear-side connection	
Direct on the switch	
Solid mm <sup>2</sup> 1 x (10 - 16) 2 x (6 - 16)	
Stranded mm <sup>2</sup> 1 x (25 - 185) 2 x (25 - 70)	
Al circular conductor	
Tunnel terminal	
Solid mm <sup>2</sup> 1 x 16	
Stranded	
Stranded mm <sup>2</sup> 1 x (25 - 185)	
Bolt terminal and rear-side connection	
Direct on the switch	
Solid mm <sup>2</sup> 1 x (10 - 16) 2 x (10 - 16)	
Stranded ${\rm mm}^2$ 1 x (25 - 50) 2 x (25 - 50)	
Cu strip (number of segments x width x segment thickness)	
Box terminal	
min. mm 2 x 9 x 0.8	
max. mm $10 \times 16 \times 0.8$ $(2x) 8 \times 15.5 \times 0.8$	
Bolt terminal and rear-side connection	
Flat copper strip, with holes min. mm 2 x 16 x 0.8	
Flat copper strip, with holes max. mm 10 x 24 x 0.8	
Copper busbar (width x thickness) mm	
Bolt terminal and rear-side connection	
Screw connection M8	
Direct on the switch	
min. mm 16 x 5	

	max.	mm	24 x 8
Control cables			
		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

# Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	20
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	5.1
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Motor protection circuit-breaker (EC000074)	
--------------------------------------------------------------------------------------------	--


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Motor protection circuit-breaker (ecl@ss10.0.1-27-37-04-01 [AGZ529016])


[AGZ529016])		
Overload release current setting	А	16 - 20
Adjustment range undelayed short-circuit release	А	350 - 350
With thermal protection		Yes
Phase failure sensitive		No
Switch off technique		Thermomagnetic
Rated operating voltage	V	690 - 690
Rated permanent current lu	Α	20
Rated operation power at AC-3, 230 V	kW	5.5
Rated operation power at AC-3, 400 V	kW	7.5
Type of electrical connection of main circuit		Screw connection
Type of control element		Rocker lever
Device construction		Built-in device fixed built-in technique
With integrated auxiliary switch		No

With integrated under voltage release		No
Number of poles		3
Rated short-circuit breaking capacity Icu at 400 V, AC	kA	150
Degree of protection (IP)		IP20
Height	mm	184
Width	mm	105
Depth	mm	149


### **Characteristics**

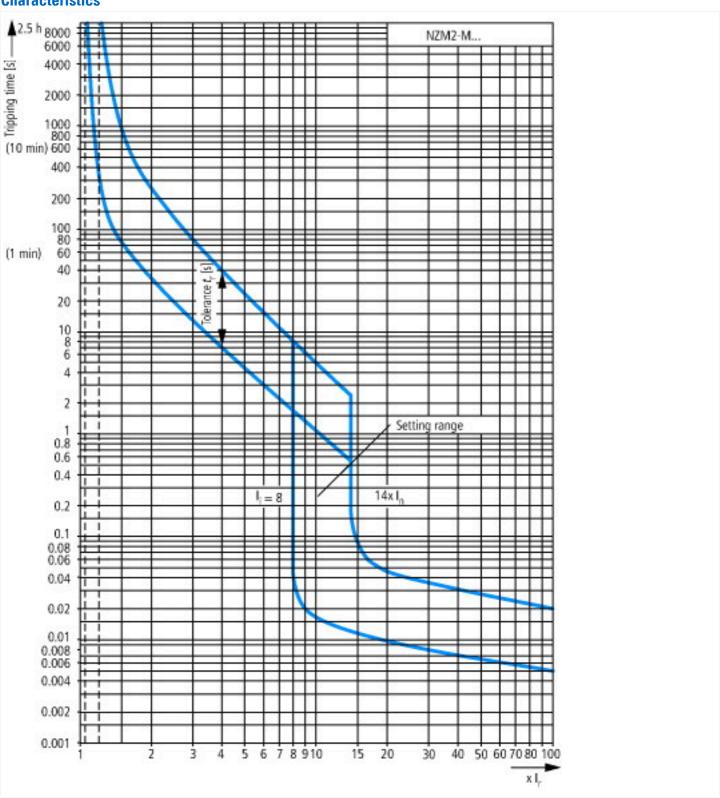

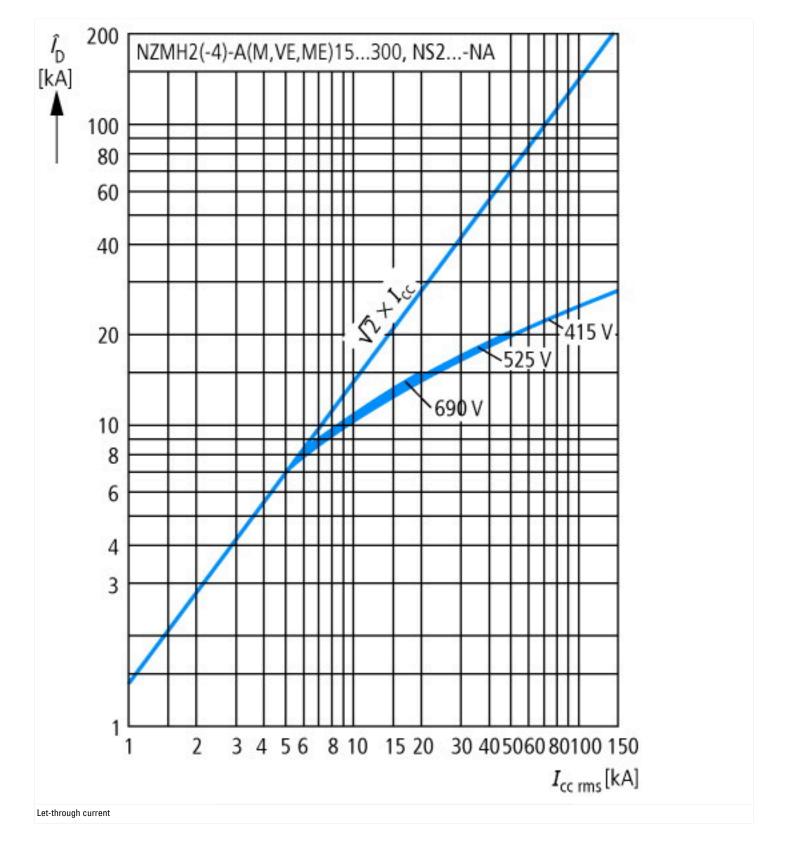


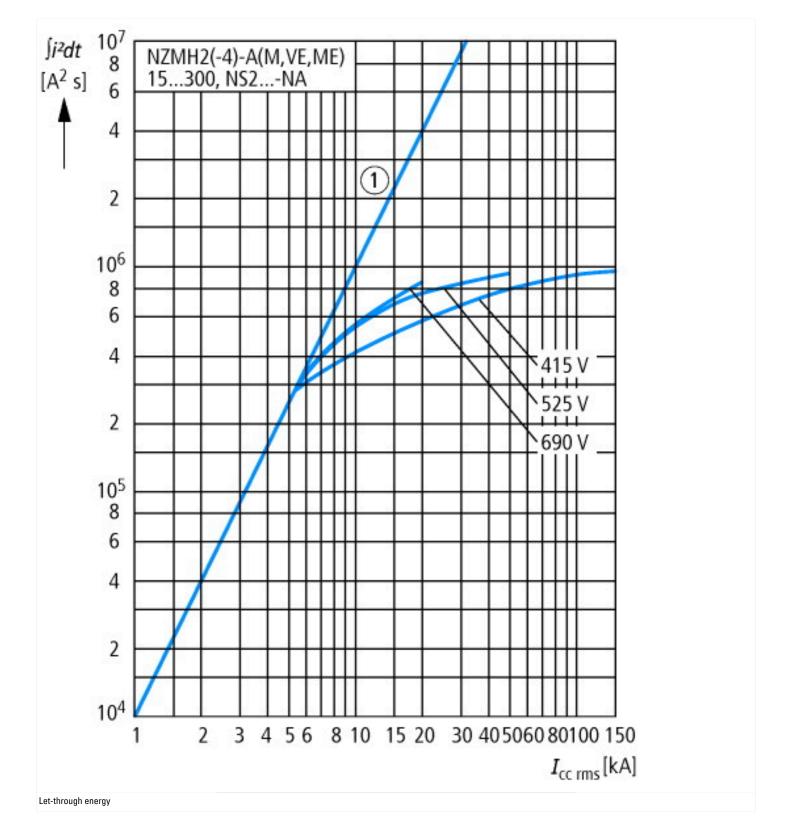

## **Dimensions**

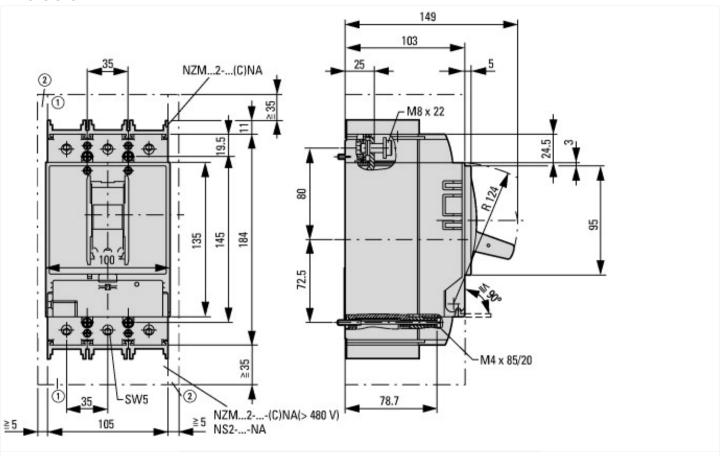

Blow out area, minimum clearance to adjacent parts
 Minimum clearance to adjacent parts

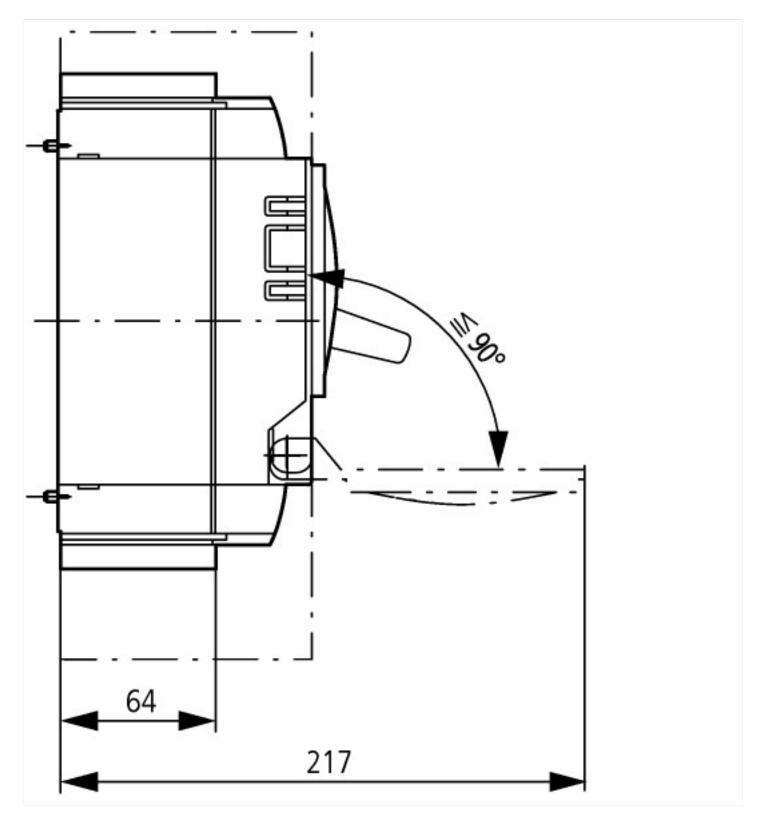

# **Additional product information (links)**

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf