DATASHEET - MSC-DE-32-M32(24VDC)



DOL starter, 380 V 400 V 415 V: 15 kW, Iq= 100 kA, Ir= 8 - 32 A, 24 V DC, DC voltage



Powering Business Worldwide™

Part no. MSC-DE-32-M32(24VDC)

Catalog No. 121752

Alternate Catalog XTSE032B032CTDNL

No.

EL-Nummer 4315131

(Norway)

Motor rating AC-3 Image: Contract of the contract of t	Delivery program			
Notes Also suitable for motors with efficiency class IP3. EST-ready devices are identified by the logs on their packaging. Motor ratings Motor rating AC 3 389 V 409 V 415 V P				DOL starters (complete devices)
Notes Connection to ShartWire-DT Motor ratings Metor rating AC3 380 V 400 V 415 V	Basic device			MSC
Motor ratings Motor rating Motor rating AC-3 SOV V P KW 15 SOV V P KW 15 SOV V P KW 16 Rated operational current AC-3 SOV 400 V 415 V I A 29.3 SOV V I A 29.9 Rated short-circuic current 300 V I I A 5 Sotting range of overload releases Contect sequence Actuating vultage Actuating vultage Actuating vultage Actuating vultage Actuating vultage Motor rating Motor rating P KW 15 SOV V P KW 16 SOV V P KW 16 SOV V P KW 16 SOV V V V V V V V V V V V V V V V V V V				IE3 ✓
Motor ratings Local Section of Local Control of Loc	Notes			Also suitable for motors with efficiency class IE3. IE3-ready devices are identified by the logo on their packaging.
Motor rating AC-3 \$80 V 400 V 415 V P kW 15 500 V Rated operational current AC-3 \$80 V 400 V 415 V Is. \$80 V 400 V 415 V Is. \$80 V 400 V 415 V Is. \$80 V V	Connection to SmartWire-DT			no
AC-3 380 V 400 V 415 V P KW 18.5 Retod operational current AC-3 380 V 400 V 415 V In ACC 380 V 400 V 415 V In ACC 380 V 400 V 415 V In ACC 8 Retod oberational current 380 V 415 V In ACC 8 Retod oberational current 380 V 415 V In ACC 8 Retod oberational short-circuit current 380 V 415 V In ACC 8 Retod oberational short-circuit current 500 V In ACC 8 Retod oberational short-circuit current 500 V In ACC 8 Reting range Setting range of overload releases Coordination Coordination Contact sequence Accussing voltage Accussing voltage Accussing voltage Exercises of the Accussing voltage	Motor ratings			
S00 V P NW 15 15 15 15 15 15 15 1	Motor rating			
Ritted operational current AC-3 380 V 400 V 415 V Is A 28.9 Ritted short-circuit current 380 - 415 V Iq IkA 100 Ratted conditional short-circuit current 500 V Iq IkA 50 Setting range Setting range of overload releases Coordination Contact sequence Actuating voltage Actuating voltage Actuating voltage I Ritted short-circuit current 500 V Is In It In	AC-3			
Rated operational current AC-3 380 V 400 V 415 V	380 V 400 V 415 V	P	kW	15
AC-3	500 V	P	kW	18.5
Setting range of overload releases Image	Rated operational current			
Souve Souv	AC-3			
Rated short-circuit current 380 - 415 V Rated conditional short-circuit current 500 V Rated conditional short-circuit current 500 V Setting range Setting range of overload releases Coordination Contact sequence Actuating voltage Rated short-circuit current 380 - 415 V Iq kA 50 Tope of coordination "1" Type of coordination "1" Type of coordination "2" Type of coordination "2" Type of coordination "2" Actuating voltage Rated short-circuit current 380 - 415 V Iq kA 50 Type of coordination "1" Type of coordination "1" Type of coordination "2" Type of coordination "1" Type of coordination "1" Type of coordination "2" Type of coordination "2" Type of coordination "1" Type of coordin	380 V 400 V 415 V	l _e	Α	29.3
Rated conditional short-circuit current 500 V Iq KA 50 Setting range of overload releases Setting range of overload releases Ir A 8 = 32 Coordination Contact sequence Actuating voltage Actuating voltage Setting range of overload releases Ir A 8 = 32 Type of coordination "1" Type of coordination "2" Type of coordination "2" Type of coordination "2" A 8 = 32 A 8 = 32 A 9	500 V	I _e	Α	28.9
Setting range of overload releases Setting range of overload releases Coordination Contact sequence Actuating voltage Setting range of overload releases Ir A 8 - 32 Type of coordination "1" Type of coordination "2" Type of coordination "2" Type of coordination "2" Type of coordination "1" Type of coordinatio	Rated short-circuit current 380 - 415 V	I_q	kA	100
Setting range of overload releases L A 8 - 32 Type of coordination "1" Type of coordination "2" Type of coordination "1" Type of coordination "2" Type of coordination "2" Type of coordination "1" Type of coordination "2" Type of coordination "2	Rated conditional short-circuit current 500 V	I_q	kA	50
Contact sequence Contact sequence Actuating voltage Type of coordination "1" Type of coordination "2" Type of coordination "2" Type of coordination "2" Type of coordination "2" Type of coordination "1" Type of coordination "2" Actually sequence 24 V DC	Setting range			
Type of coordination "2" Contact sequence M 3 Actuating voltage Z4 V DC	Setting range of overload releases	I _r	А	8 - 32
Actuating voltage 24 V DC	Coordination			Type of coordination "1" Type of coordination "2"
	Contact sequence			
	Actuating voltage			24 V DC

Motor-protective circuit-breakers PKE32/XTU-32

Contactor DILM32-10(...)

DOL starter wiring set

Mechanical connection element and electrical electric contact module PKZM0-XDM32

Notes

The DOL starter (complete devices) consists of a PKE motor protective circuit breaker and a DILM contactor.

With the adapter-less top-hat rail mounting of starters up to 15 A, only the motor-protective circuit-breaker on the top-hat rail requires an adapter.

The contactors are provided with mechanical support via a mechanical connection element.

Control wire guide with max. 6 conductors up to 2.5°mm external diameter or 4 conductors up to 3.5°mm external diameter.

From 16 A, the motor-protective circuit-breaker and contactor are mounted on the top-hat rail adapter plate.

The connection of the main circuit between PKE and contactor is established with electrical contact modules.

When using DILA-XHIT... auxiliary contacts with MSC-DE-... DOL starters, the plug-in electrical connectors can be removed without removing the front-mounted auxiliary contact.

Cannot be combined with NHI-E...PKZ0-C.

MSC-DEA... DOL starters are prepared for communications via SmartWire-DT. In order to be used this way, they first need to be expanded with the PKE-SWD-32 communications module.

Motor output/rated n	notor current						
Motor	Rated motor						
output	current						
AC-3							
	220 V	380 V	415 V	440 V	500 V	500 V	660 V
	230 V	400 V				with	690 V
	240 V					CL-PKZ0	
	$I_0 = 100 \text{ kA}$	$I_{\alpha} = 100 \text{ kA}$	$I_0 = 65 \text{ kA}$	$I_q = 65 \text{ kA}$	$I_{\alpha} = 50 \text{ kA}$	$I_q = 100 \text{ kA}$	$I_{\alpha} = 3 \text{ kA}$
P	ı'	ı'	ı'	ľ	ľ	ı'	ľ
kW	Α	Α	Α	Α	Α	Α	Α
2.2	8.7	-	-	-	-	=	-
3	11.5	-	-	-	-	-	-
4	14.8	8.5	8.5	-	-	-	-
5.5	19.6	11.3	11.3	10.2	9	9	-
7.5	26.4	15.2	15.2	13.8	12.1	12.1	8.8
11	-	21.7	21.7	19.7	17.4	17.4	12.6
15	-	29.3	29.3	26.6	23.4	23.4	17
18.5	-	-	-	-	28.9	28.9	-

IEC/EN 60947-4-1, VDE 0660

Technical data

General Standards

Mounting position			
Ambient temperature			-25 - +55
Main conducting paths			
Rated impulse withstand voltage	U_{imp}	V AC	6000
Overvoltage category/pollution degree			III/3
Rated operational voltage	U _e	V	230 - 415
Rated operational current			
Open, 3-pole: 50 – 60 Hz			
380 V 400 V	l _e	Α	32
AC-4 cycle operation			
Minimum current flow times		ms	500 (Class 5) 700 (Class 10) 900 (Class 15) 1000 (Class 20)
Minimum cut-out periods		ms	500
Note		ms	In AC-4 cycle operation, going below the minimum current flow time can cause overheating of the load (motor). For all combinations with an SWD activation, you need not adhere to the minimum current flow times and minimum cut-out periods.
Additional technical data			
Motor protective circuit breaker PKZM0, PKE			PKZM0 motor-protective circuit-breakers, see motor-protective circuit-breakers/ PKZM0 product group DILM contactors, see contactor product group

			DILET timing relay, ETR, see contactors, electronic timing relays product group
DILM contactors			
Current heat loss			
Current heat loss at I_e to AC-3/400 V		W	10.5
Power consumption			
DC operated	Sealing	W	0.86
Rating data for approved types			
Short Circuit Current Rating		SCCR	
Basic Rating			
SCCR		kA	10

Design verification as per IEC/EN 61439

besign vermeation as per 120/214 01-405			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	32
Heat dissipation per pole, current-dependent	P _{vid}	W	3.5
Equipment heat dissipation, current-dependent	P_{vid}	W	10.5
Static heat dissipation, non-current-dependent	P _{vs}	W	0.86
Heat dissipation capacity	P _{diss}	W	0
Operating ambient temperature min.	4.00	°C	-25
Operating ambient temperature max.		°C	55
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Motor starter/Motor starter combination (EC001037)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Load breakout, motor breakout / Motor starter combination (ecl@ss10.0.1-27-37-09-05 [AJZ718013])

[A027 100 10]]		
Kind of motor starter		Direct starter
With short-circuit release		Yes
Rated control supply voltage Us at AC 50HZ	V	0 - 0
Rated control supply voltage Us at AC 60HZ	V	0 - 0

D. I I. I. II. II. II.	.,	04.04
Rated control supply voltage Us at DC		24 - 24
Voltage type for actuating		DC
Rated operation power at AC-3, 230 V, 3-phase		7.5
Rated operation power at AC-3, 400 V		15
Rated power, 460 V, 60 Hz, 3-phase		0
Rated power, 575 V, 60 Hz, 3-phase		0
Rated operation current le		29.3
Rated operation current at AC-3, 400 V		32
Overload release current setting	А	8 - 32
Rated conditional short-circuit current, type 1, 480 Y/277 V		0
Rated conditional short-circuit current, type 1, 600 Y/347 V	Α	0
Rated conditional short-circuit current, type 2, 230 V	Α	100000
Rated conditional short-circuit current, type 2, 400 V	Α	100000
Number of auxiliary contacts as normally open contact		1
Number of auxiliary contacts as normally closed contact		0
Ambient temperature, upper operating limit	°C	60
Temperature compensated overload protection		Yes
Release class		Adjustable
Type of electrical connection of main circuit		Screw connection
Type of electrical connection for auxiliary- and control current circuit		Screw connection
Rail mounting possible		Yes
With transformer		No
Number of command positions		0
Suitable for emergency stop		No
Coordination class according to IEC 60947-4-3		Class 2
Number of indicator lights		0
External reset possible		No
With fuse		No
Degree of protection (IP)		IP20
Degree of protection (NEMA)		Other
Supporting protocol for TCP/IP		No
Supporting protocol for PROFIBUS		No
Supporting protocol for CAN		No
Supporting protocol for INTERBUS		No
Supporting protocol for ASI		No
Supporting protocol for MODBUS		No
Supporting protocol for Data-Highway		No
Supporting protocol for DeviceNet		No
Supporting protocol for SUCONET		No
Supporting protocol for LON		No
Supporting protocol for PROFINET IO		No
Supporting protocol for PROFINET CBA		No
Supporting protocol for SERCOS		No
Supporting protocol for Foundation Fieldbus		No
Supporting protocol for EtherNet/IP		No
Supporting protocol for AS-Interface Safety at Work		No
Supporting protocol for DeviceNet Safety		No
Supporting protocol for INTERBUS-Safety		No
Supporting protocol for PROFIsafe		No
Supporting protocol for SafetyBUS p		No
Supporting protocol for other bus systems		No
Width		45
Height		242
Depth		128

Dimensions

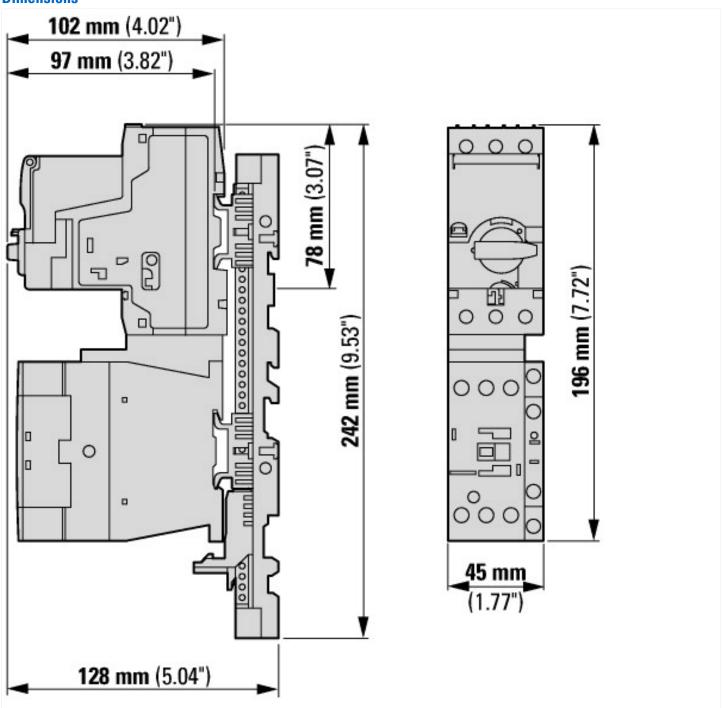

Assets (links)

Declaration of CE Conformity 00003119

Instruction Leaflets

IL03402010Z2018_05

Additional product information (links)

IL03402010Z (AWA1210-2265) DOL starter up to 32 A

 $IL03402010Z \ (AWA1210-2265) \ DOL \ starter \ up \ to \\ ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03402010Z2018_05.pdf$

32 A

Moeller_Online Selections Aids http://www.moeller.net/en/support/slider/index.jsp