DATASHEET - NZMN1-4-A40



Circuit-breaker, 4p, 40A

Part no.

Catalog No.

(Norway)

NZMN1-4-A40 265811

EL-Nummer 4358821



Similar to illustration

Delivery program

Product rangeCircuit-breakerProduct rangeCircuit-breakerProduct rangeSystem and calle protectionStandard/Approx1ISolutionRelease systemISolutionConstructions sizeIImmon agnetic releaseConstructions sizeImmon agnetic releaseSocieptionImmon agnetic releaseNumber of polsImmon agnetic releaseStandard equipmentImmon agnetic releaseSwitching capacityImmon agnetic releaseAndrad equipmentImmon agnetic releaseSwitching capacityImmon agnetic releaseImmon agnetic releaseImmon agnetic releaseImmon agnetic releaseImmon agnetic releaseShort-circuit releasesImmon agnetic releaseImmon agne				
Standard/ApprovalICInstallation typeICFixedRelease systemICFixedConstruction sizeICICDescriptionICICNumber of polesICStandard equipmentSwitching capacityICIC400415 V 50 HzIcuKARated current = rated uninterrupted currentIcuICNumber of polesIcuICuRated current = rated uninterrupted currentIcuICuVertiods tripIcuIcuIcuNeutral conductorIcuIcuIcuInterrupted currentIcuIcuIcuNeutral conductorIcuIcuIcuInterrupted currentIcuIcuIcuNeutral conductorIcuIcuIcuSetting rangeIcuIcuIcuInterrupted currentIcuIcuIcuInterrupted currentIcuIcuI	Product range			Circuit-breaker
Installation typeFixedFixedRelease system $I = I = I = I = I = I = I = I = I = I =$	Protective function			System and cable protection
Arrow and the set of th	Standard/Approval			IEC
Construction size NZM1 Description Set value in neutral conductor is synchronous with set value ir of main pole. Number of poles A pole Standard equipment Box terminal Switching capacity Icu KA 400/415 V 50 Hz Icu KA Rated current = rated uninterrupted current In = I ₀ A Neutral conductor So fights % Overload trip In = I ₀ A Overload trip Ir A Standard equipment Short-circuit releases Ir A Standard equipment	Installation type			Fixed
DescriptionIISet value in neutral conductor is synchronous with set value Ir of main pole.Number of poles4 poleStandard equipmentBox terminalSwitching capacityIcuKA400/415 V 50 HzIcuKARated current = rated uninterrupted currentIn = IuANeural conductor% of phase%0verload tripConductor% of phase0verload tripIrAMain poleIrAStort- circuit releasesIrANon-delayedIr=Iu xANon-delayedIr=Iu xBNon-delayedIr=Iu xBABAIrStort- circuit releasesStort- circuit releasesNon-delayedIr=Iu xBIrStort- circuit releasesStort- circuit releasesNon-delayedIr=Iu xBABAIrStort- circuit releasesIrStort- circuit releasesIrIrStort- circuit releasesIrIrSt	Release system			Thermomagnetic release
Number of polesImage: Standard equipmentImage: Standard equipment <th< td=""><td>Construction size</td><td></td><td></td><td>NZM1</td></th<>	Construction size			NZM1
Standard equipment Image: S	Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Switching capacity Icu KA 400/415 V 50 Hz Icu KA Rated current = rated uninterrupted current In = Iu A Rated current = rated uninterrupted current In = Iu A Neutral conductor In = Iu A Neutral conductor In = Iu A Overload trip Intervention Intervention Image: Intervention Intervention Intervention Main pole Ir A Image: Intervention Ir A Non-delayed Intervention Intervention Image: Intervention Intervention Intervention	Number of poles			4 pole
400/415 V 50 HzIcuKA50Rated current = rated uninterrupted current $n = l_u$ A40Rated current = rated uninterrupted current $n = l_u$ A40Neutral conductor% of phase conductor% of100Setting range Overload trip $I_r = I_u$ A32-40Main pole Image I_r A32-40Non-delayed $I_r = I_u$ A32-40Non-delayed $I_r = I_u$ $I_r = I_u$ ANon-delayed $I_r = I_u$ $I_r = I_u$ A	Standard equipment			Box terminal
Rated current = rated uninterrupted current Image Image Retring range Verload trip Verload trip Overload trip Ir A Main pole Ir A Short-circuit releases Ir A Non-delayed I=In x S-10	Switching capacity			
Rated current = rated uninterrupted current In = Iu A 4 Neutral conductor % of phase % of phase Overload trip % of phase % % of phase % % of phase % % of phase % % of	400/415 V 50 Hz	l _{cu}	kA	50
Neutral conductor % of phase conductor % of phase conductor % of phase section % of phase section % of phase	Rated current = rated uninterrupted current			
Setting range Conductor Overload trip	Rated current = rated uninterrupted current	$I_n = I_u$	Α	40
Overload tripImage: set of the	Neutral conductor	% of phase conductor	%	100
Image: height bound	Setting range			
Main pole Image: Short-circuit releases Image	Overload trip			
Image: Description of the set of	द	l _r	A	32 - 40
Non-delayed I _i = I _n x 8 - 10	Main pole	l _r	A	32 - 40
中				
Short-circuit releases Irm A 320 - 400	Non-delayed	$I_i = I_n \times \dots$		8 - 10
	Short-circuit releases	I _{rm}	A	320 - 400

Technical data

	IEC/EN 60947
	Finger and back of hand proof to VDE 0106 Part 100
	Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
°C	- 40 - + 70
°C	-25 - +70
g	20 (half-sinusoidal shock 20 ms)
V AC	5 00
	°C g

between the suviliany contracts		VAC	200
between the auxiliary contacts		V AC	300
Mounting position			Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers		٨	10
Rated current = rated uninterrupted current	I _n = I _u	A	40
Rated surge voltage invariability	U _{imp}		
Main contacts		V	6000
Auxiliary contacts		V	6000
Rated operational voltage	Ue	V AC	690
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 690
Switching capacity			
Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	187
400/415 V	I _{cm}	kA	105
440 V 50/60 Hz	I _{cm}	kA	74
525 V 50/60 Hz	I _{cm}	kA	40
690 V 50/60 H	lc	kA	17
Rated short-circuit breaking capacity I _{cn}	I _{cn}		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	
240 V 50/60 Hz	I _{cu}	kA	85
400/415 V 50/60 Hz	l _{cu}	kA	50
440 V 50/60 Hz	I _{cu}	kA	35
525 V 50/60 Hz	I _{cu}	kA	20
690 V 50/60 Hz	l _{cu}	kA	10
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA	
240 V 50/60 Hz	I _{cs}	kA	85
400/415 V 50/60 Hz	I _{cs}	kA	50
440 V 50/60 Hz	I _{cs}	kA	35
525 V 50/60 Hz	I _{cs}	kA	10
690 V 50/60 Hz	I _{cs}	kA	7.5
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			Α
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
40.1			
AC-1			
400 V 50/60 Hz	Operations		10000

690 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Box terminal
Optional accessories			Screw connection Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (10 - 70) ³⁾ 2 x (6-25)
			$^{3)}$ Up to 95 $\rm mm^2$ can be connected depending on the cable manufacturer.
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
1-hole		mm ²	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		2	1(1010)
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (10 - 70) ³⁾ 2 x 25
			$^{3)}$ Up to 95 mm² can be connected depending on the cable manufacturer.
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 35) 2 x (25 - 35)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	9 x 9 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M6
Direct on the switch			
	min.	mm	12 x 5
	max.	mm	16 x 5
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	I _n	А	40
Equipment heat dissipation, current-dependent	P _{vid}	W	10.66
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			


10.2 Strength of materials and parts	
10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

Rated permanent current lu	А	40
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Overload release current setting	А	32 - 40
Adjustment range short-term delayed short-circuit release	А	0 - 0
Adjustment range undelayed short-circuit release	А	8 - 10
Integrated earth fault protection		No
Type of electrical connection of main circuit		Frame clamp
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		4
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		No
Degree of protection (IP)		IP20

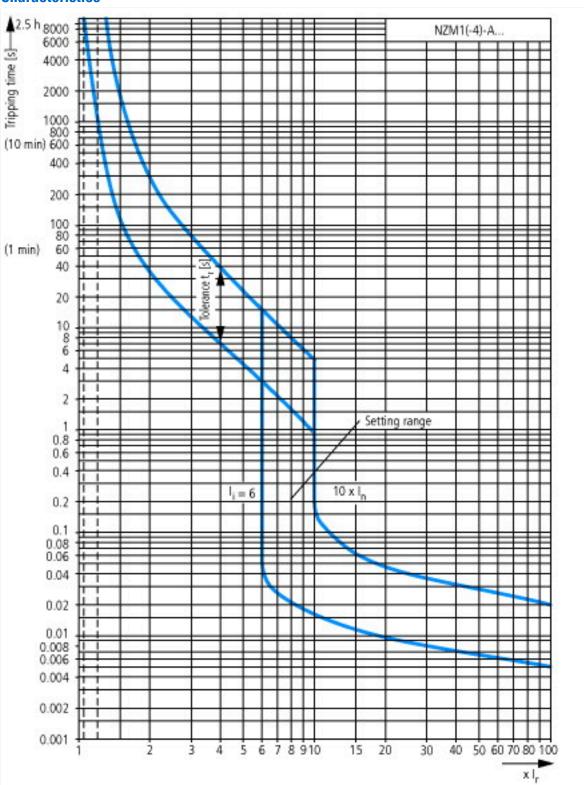



Characteristics

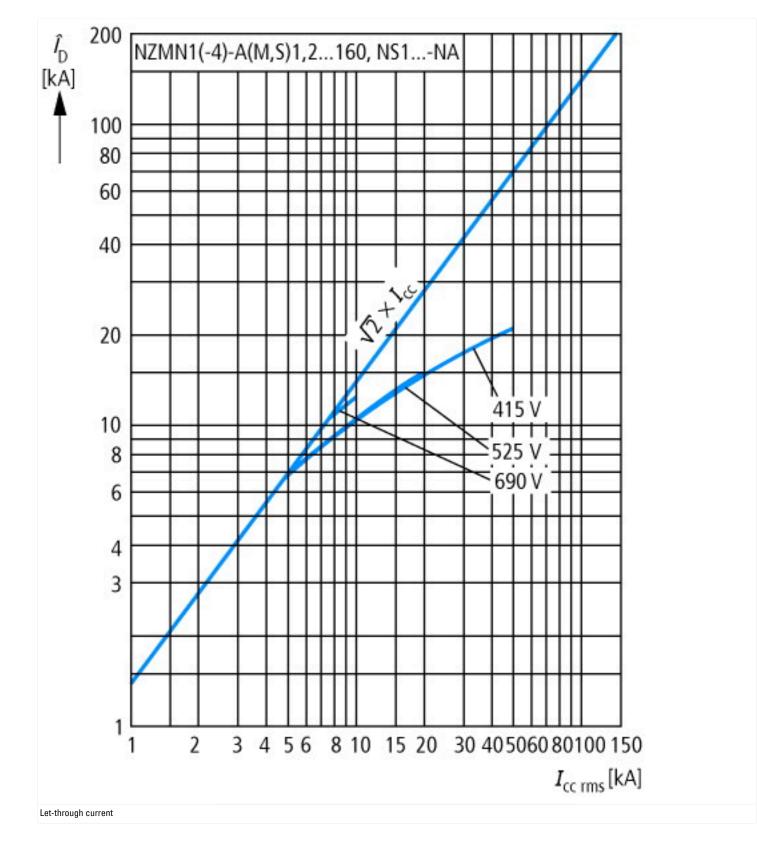

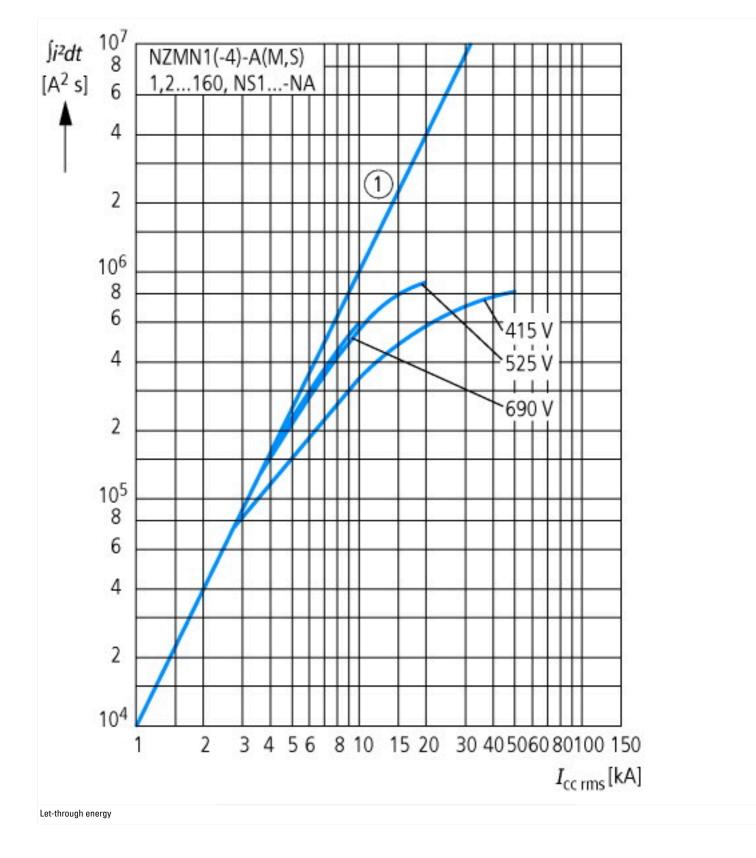



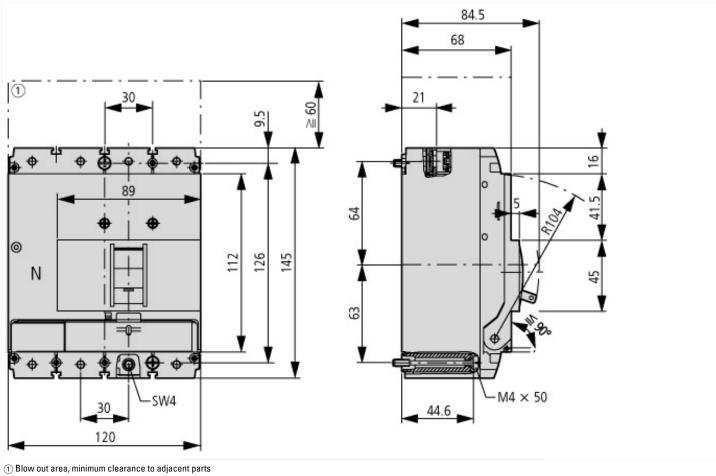

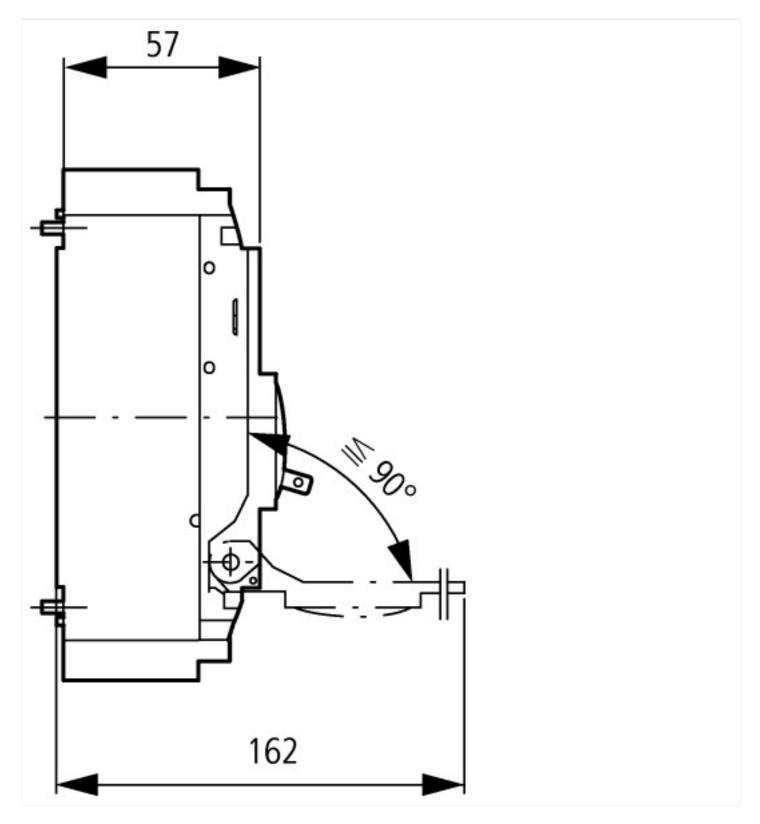

Additional product information (links)

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/ index.htm
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf