## **DATASHEET - NZMN2-4-A200**



Circuit-breaker, 4p, 200A

Part no. NZMN2-4-A200 Catalog No. 265863



Similar to illustration

Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
nstallation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM2
Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Number of poles			4 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I <sub>cu</sub>	kA	50
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$\mathbf{I}_n = \mathbf{I}_u$	Α	200
Neutral conductor	% of phase conductor	%	100
Setting range			
Overload trip			
中	I <sub>r</sub>	Α	160 - 200
Main pole	I <sub>r</sub>	A	160 - 200
Short-circuit releases			
Non-delayed	$I_i = I_n \times \dots$		6 - 10
Short-circuit releases	I <sub>rm</sub>	A	1200 - 2000

### **Technical data**

General

General			
Standards			IEC/EN 60947
Protection against direct contact			Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Ambient temperature, storage	c	°C	- 40 - + 70
Operation	c	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	(	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts	\	V AC	500
between the auxiliary contacts	\	V AC	300

Mounting position			Vertical and 90° in all directions  With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers  Rated current = rated uninterrupted current	$I_n = I_u$	Α	200
Rated surge voltage invariability	U <sub>imp</sub>	,	
Main contacts	Uimp	V	8000
Auxiliary contacts		V	6000
Rated operational voltage	U <sub>e</sub>	V AC	690
Overvoltage category/pollution degree	O g	7710	III/3
Rated insulation voltage	Ui	V	1000
Use in unearthed supply systems	01	V	≦ 690
Switching capacity		•	- 000
Rated short-circuit making capacity	I <sub>cm</sub>		
240 V	I <sub>cm</sub>	kA	187
400/415 V	I <sub>cm</sub>	kA	105
440 V 50/60 Hz	I <sub>cm</sub>	kA	74
525 V 50/60 Hz	I <sub>cm</sub>	kA	53
690 V 50/60 H	Ic	kA	40
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>		
Icu to IEC/EN 60947 test cycle 0-t-C0	Icu	kA	
240 V 50/60 Hz	I <sub>cu</sub>	kA	85
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	50
440 V 50/60 Hz	I <sub>cu</sub>	kA	35
525 V 50/60 Hz	I <sub>cu</sub>	kA	25
690 V 50/60 Hz	I <sub>cu</sub>	kA	20
lcs to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA	
240 V 50/60 Hz	I <sub>cs</sub>	kA	85
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	50
440 V 50/60 Hz	I <sub>cs</sub>	kA	35
525 V 50/60 Hz		kA	25
690 V 50/60 Hz	I <sub>cs</sub>	kA	5
550 ¥ 50/00 Hz	I <sub>cs</sub>	NA.	Maximum back-up fuse, if the expected short-circuit currents at the installation
Rated short-time withstand current			location exceed the switching capacity of the circuit-breaker.
t = 0.3 s	lav	kA	1.9
t=1s	I <sub>cw</sub>		
	I <sub>cw</sub>	kA	1.9
Utilization category to IEC/EN 60947-2	Operations		A 20000
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)  Lifespan, electrical	Operations		20000

400 V 50/00 V			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
AC3			
400 V 50/60 Hz	Operations		6500
415 V 50/60 Hz	Operations		6500
690 V 50/60 Hz	Operations		5000
Max. operating frequency		0ps/h	120
Total break time at short-circuit		ms	< 10
Terminal capacity			
Standard equipment			Screw connection
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm <sup>2</sup>	1 x (10 - 16)
			2 x (6 - 16)
Stranded		mm <sup>2</sup>	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal		2	1 v 16
Solid		mm <sup>2</sup>	1 x 16
Stranded			
1-hole		$mm^2$	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm <sup>2</sup>	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		$\mathrm{mm}^2$	1 x 16
Stranded			
Stranded		mm <sup>2</sup>	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm <sup>2</sup>	1 x (10 - 16)
			2 x (10 - 16)
Stranded		mm <sup>2</sup>	1 x (25 - 50) 2 x (25 - 50)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 x 5
	max.	mm	24 x 8
Control cables			
		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

# Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	200
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	48
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

#### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Rated voltage  Rated short-circuit breaking capacity Icu at 400 V, 50 Hz  Diverload release current setting  Adjustment range short-term delayed short-circuit release  Adjustment range undelayed s	protection (eci@ss10.0.1-27-37-04-09 [AJZ/10013])		
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz  A 160 - 200  Adjustment range short-term delayed short-circuit release A 0 - 0  Adjustment range undelayed short-circuit release A 6 - 10  Integrated earth fault protection Integrated e	Rated permanent current lu	Α	200
Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  A 160 - 200  A 160	Rated voltage	V	690 - 690
Adjustment range short-term delayed short-circuit release ADJustment range undelayed short-circuit release ADJUSTMENT RANGE ADJUSTM	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Adjustment range undelayed short-circuit release A 6 - 10 Integrated earth fault protection No Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release  A 6 - 10 No Screw connection Built-in device fixed built-in technique No  O O O O O O O O O O O O O O O O O O	Overload release current setting	Α	160 - 200
Integrated earth fault protection  Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  No  No  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  No  No  No  No  No  No  No  No  No  N	Adjustment range short-term delayed short-circuit release	А	0 - 0
Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  Screw connection  Built-in device fixed built-in technique  No  No  Ves  0  Ves  0  0  0  Ves  No  No  No  No  No  No  No  No  No  N	Adjustment range undelayed short-circuit release	А	6 - 10
Device construction  Built-in device fixed built-in technique  No  DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Yes  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  O  With switched-off indicator  With under voltage release  Built-in device fixed built-in technique  No  Yes  0  0  Ves  No  No  No  No  No  No  No  No  No  N	Integrated earth fault protection		No
Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Yes  Number of auxiliary contacts as normally closed contact  0  Number of auxiliary contacts as normally open contact  0  Number of auxiliary contacts as change-over contact  0  With switched-off indicator  No  With under voltage release  No	Type of electrical connection of main circuit		Screw connection
DIN rail (top hat rail) mounting optional  Yes  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  No	Device construction		Built-in device fixed built-in technique
Number of auxiliary contacts as normally closed contact  0  Number of auxiliary contacts as normally open contact  0  Number of auxiliary contacts as change-over contact  0  With switched-off indicator  No  With under voltage release  No	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  No	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact  With switched-off indicator  No  With under voltage release  No	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator No	Number of auxiliary contacts as normally open contact		0
With under voltage release No	Number of auxiliary contacts as change-over contact		0
	With switched-off indicator		No
Number of poles 4	With under voltage release		No
	Number of poles		4

Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20


#### **Characteristics**

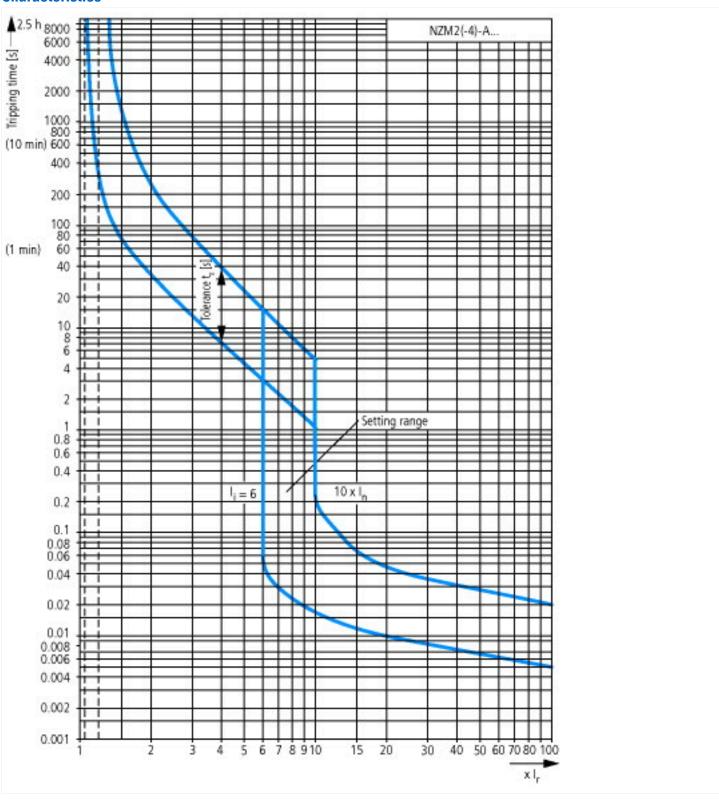


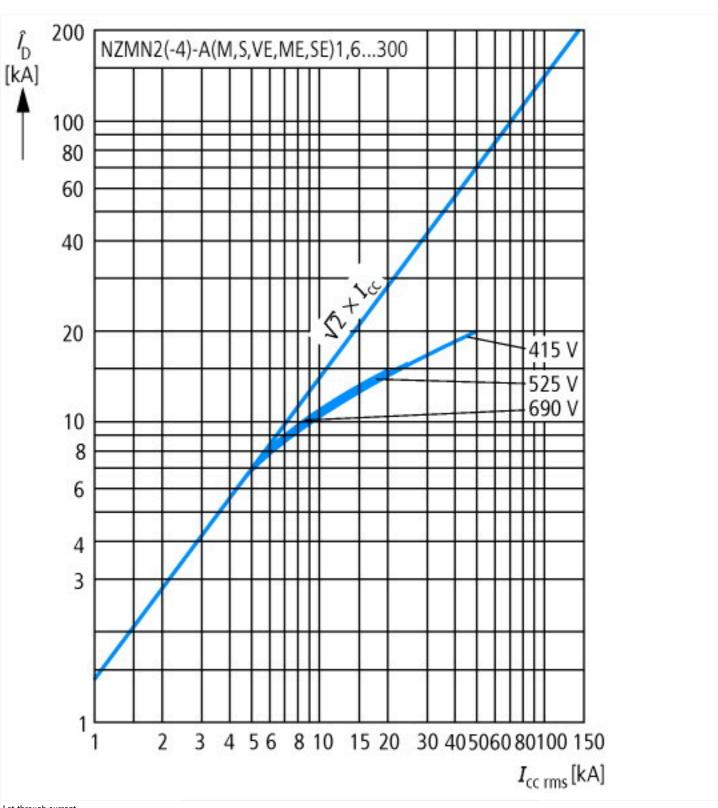

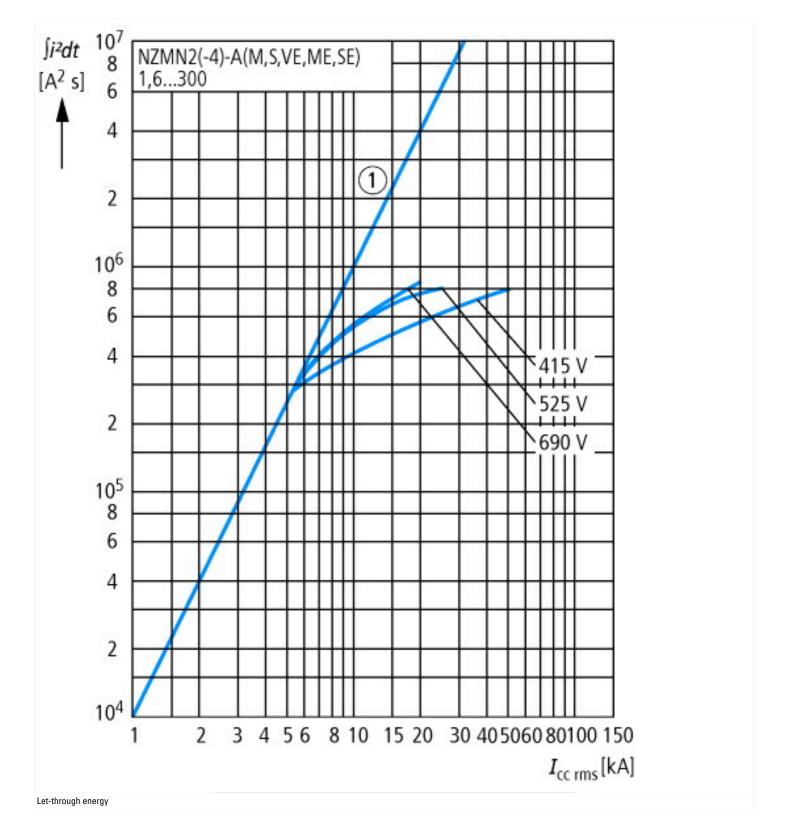

# **Dimensions**

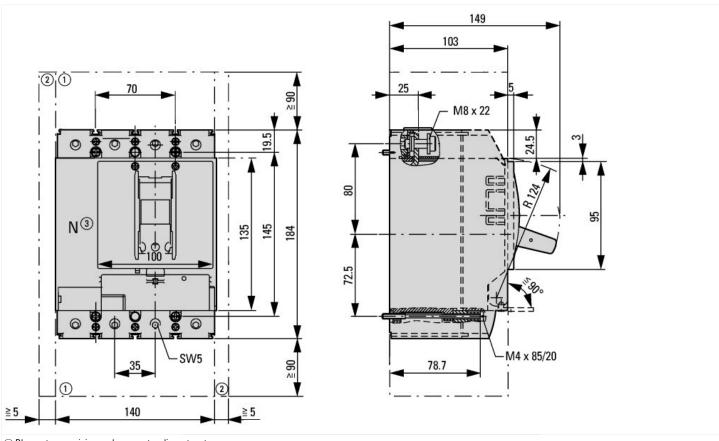

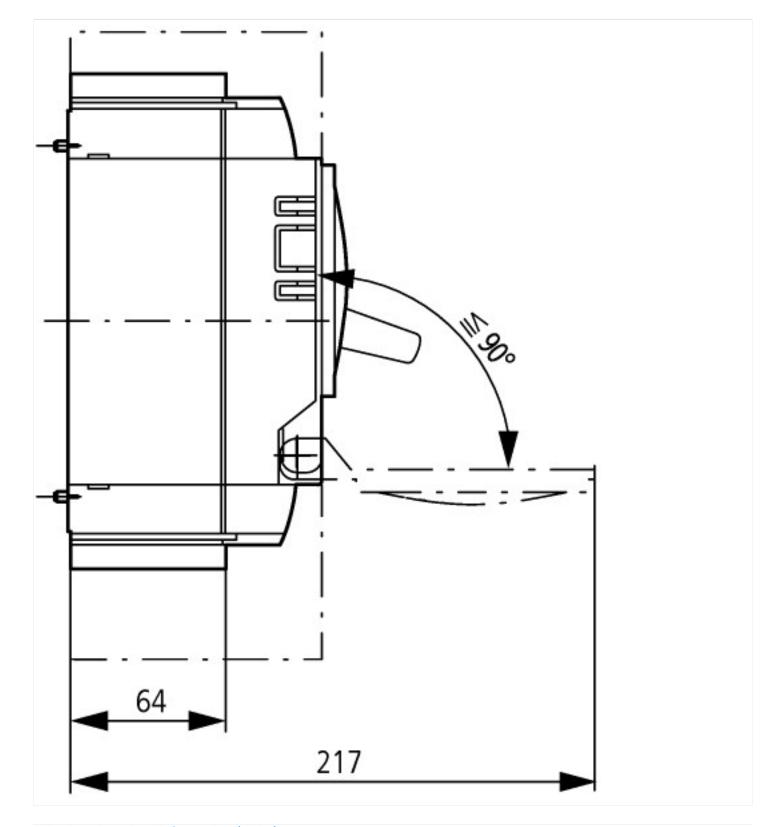

# Additional product information (links)

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf