



Automatización Eléctrica

Especialistas en Automatización

At the end of this document you will find links to products related to this catalog. You can go directly to our shop by clicking HERE. <u>HERE</u>



40A DC UPS Module

DR-UPS40



Features :

- Battery controller for DIN Rail UPS system
- Parallel connection to DC BUS
- Suitable for 24V system up to 40A
- Installed on DIN Rail TS35 / 7.5 or 15
- Built-in battery test function
- Battery polarity protection
- Relay contact signal output and LED indicator for DC BUS OK, Battery Fail, and Battery Discharge
- Cooling by free air convection
- 3 years warranty


CE

SPECIFICATION

MODEL		DR-UPS40		
DC INPUT / DC VOLTAGE (Typ.) Note.5		24~29V		
DC BUS	RATED CURRENT	40A		
BATTERY INPUT / OUTPUT	VOLTAGE RANGE (Typ.)	21 ~ 29V		
	CURRENT RANGE	0~40A		
	CHARGE CURRENT (Typ.) Note.4	2A		
	EXTERNAL BATTERY (Typ.)	4 / 7 / 12AH / 24V		
FUNCTION	RELAY CONTACT RATING (max.)	30VDC, 1A		
	DC BUS OK	Relay contact : Short when DC voltage between 21~29V(±3%), relay contacts		
		LED(Green) : DC BUS OK : light ; DC BUS fail : dark		
	BATTERY FAIL Note 2	$Short when battery voltage falls below 21.9V (\pm 3\%) or battery failure is observed through the battery test function, relay contacts and the state of the state$		
		LED(Red) : Battery over-discharge warning or battery broken : light ; Battery OK : dark		
	BATTERY DISCHARGE	Relay contact : Short when battery in discharge condition, relay contacts		
		LED(Yellow) : Battery discharging : light ; Battery is not discharging or discharging current<2.0A : dark		
ENVIRONMENT	WORKING TEMP.	-20 ~ +70°C		
	WORKING HUMIDITY	20~90% RH		
	STORAGE TEMP., HUMIDITY	-20 ~ +85°C, 10 ~ 95% RH		
	VIBRATION	Component : 10 ~ 500Hz, 2G 10min./1cycle, 60min. each X, Y, Z axes ; Mounting : Compliance to IEC600068-2-6		
SAFETY & EMC (Note 3)	WITHSTAND VOLTAGE	Terminal-Chassis :0.5KVAC, Relay Contacts-Terminal :0.5KVAC		
	ISOLATION RESISTANCE	Terminal-Chassis :>100M Ohms / 500VDC / 25°C / 70% RH		
	EMC EMISSION	Compliance to EN55022 (CISPR22) Class B, EN61000-3-2,-3		
	EMC IMMUNITY	Compliance to EN61000-4-2,3,4,5,6,8,11, heavy industry level, criteria A		
OTHERS	MTBF	161.9Khrs min. MIL-HDBK-217F (25°C)		
	DIMENSION	55.5*125.2*100mm (W*H*D)		
	PACKING	0.55Kg; 20pcs/12Kg/1.29CUFT		
NOTE	 All parameters NOT specially mentioned are measured at rated load and 25℃ of ambient temperature. Battery fail will only function at UPS mode with battery connected. Every 25 seconds, unit will send out test signal through "Battery Fail" relay contact and LED indicator once the battery is fail. The power supply is considered a component which will be installed into a final equipment. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com) Battery charging will be in progress when DC input > battery voltage. DR-UPS40 will be in operation when DC input is applied at the beginning. 			




DR-UPS40

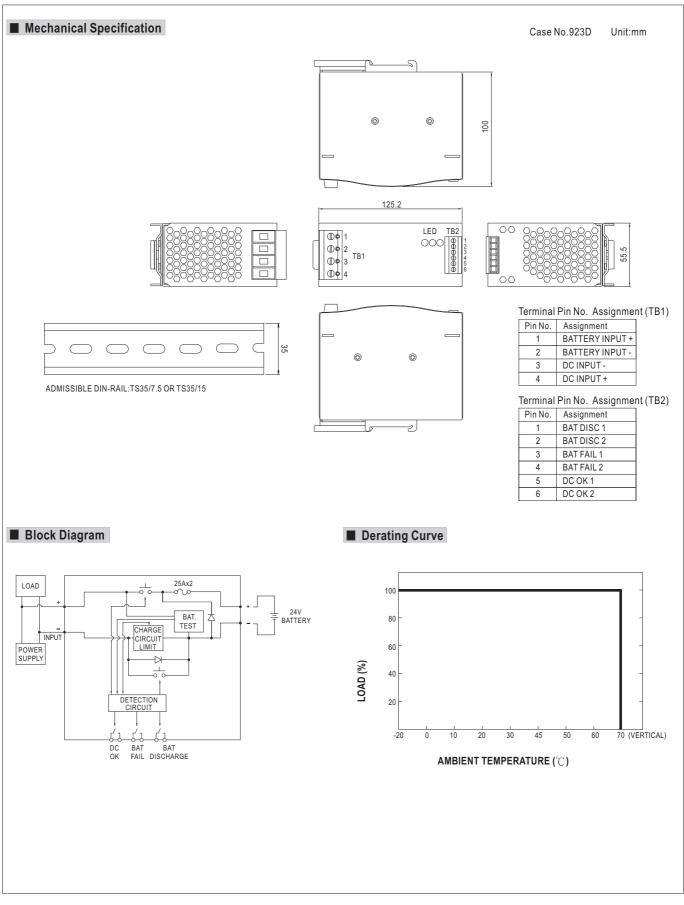



Suggested Application



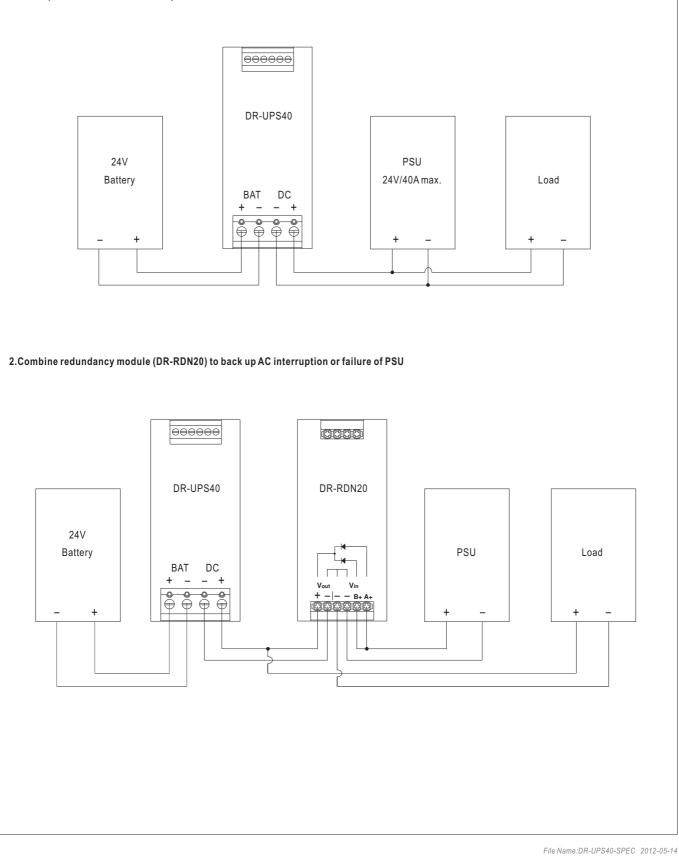





Below is a list of articles with direct links to our shop Electric Automation Network where you can see:

- Quote per purchase volume in real time.
- Online documentation and datasheets of all products.
- Estimated delivery time enquiry in real time.
- Logistics systems for the shipment of materials almost anywhere in the world.
- Purchasing management, order record and tracking of shipments.

To access the product, <u>click on the green button</u>.

Product	Code	Reference	Product link
Input: 21-28 DC, Output: 1, V1: 24, A1: 20	DRRDN20	DR-RDN20	Buy on EAN
Input: 24-29 DC, Output: 1, V1: 24, A1: 40	DRUPS40	DR-UPS40	Buy on EAN