DATASHEET - NZMB2-4-A300/200



Circuit-breaker, 4p, 300A, 200A in 4th pole

Part no. NZMB2-4-A300/200 Catalog No. 107583



Similar to illustration

Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM2
Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Number of poles			4 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	25
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	300
Neutral conductor	% of phase conductor	CSA	60
Reduced neutral conductor protection		Α	200
Neutral conductor protection			Reduced neutral conductor protection
Setting range			
Overload trip			
中	I _r	Α	240 - 300
Main pole	I _r	A	160 - 200
Short-circuit releases			
Non-delayed	$I_i = I_n x \dots$		5 - 8.3
Short-circuit releases	I _{rm}	Α	2000 - 2500

Technical data

General

Gonoral			
Standards			IEC/EN 60947
Protection against direct contact			Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Ambient temperature, storage	0	C	- 40 - + 70
Operation	0	C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	1	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140			

Between auxiliary contacts and main contacts		V AC	500	
between the auxiliary contacts		V AC	300	
Weight		kg	3.5	
Mounting position		''9	Vertical and 90° in all directions	
wounting position			90° 90° 90°	With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required	
Degree of protection				
Device			In the operating controls area: IP2	0 (basic degree of protection)
Enclosures			With insulating surround: IP40	
			With door coupling rotary handle:	IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal:	P00
Other technical data (sheet catalogue)			Temperature dependency, Deratir	
Circuit-breakers			p	•
Rated current = rated uninterrupted current	$I_n = I_u$	Α	300	
Rated surge voltage invariability	U _{imp}			
Main contacts	·	٧	8000	
Auxiliary contacts		٧	6000	
Rated operational voltage	U _e	V AC	440	
Overvoltage category/pollution degree	-6		III/3	
Rated insulation voltage	Ui	V	690	
	O _I			
Use in unearthed supply systems		V	≦ 440	
Switching capacity Rated short-circuit making capacity	1			
	I _{cm}	I. A	60	
240 V	I _{cm}	kA	63	
400/415 V	I _{cm}	kA	53	
440 V 50/60 Hz	I _{cm}	kA	53	
Rated short-circuit breaking capacity I _{cn}	I _{cn}			
Icu to IEC/EN 60947 test cycle O-t-CO	lcu	kA		
240 V 50/60 Hz	I _{cu}	kA	30	
400/415 V 50/60 Hz	I _{cu}	kA	25	
440 V 50/60 Hz	I _{cu}	kA	25	
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA		
240 V 50/60 Hz		kA	30	
	I _{cs}			
400/415 V 50/60 Hz	I _{CS}	kA	25	
440 V 50/60 Hz	I _{cs}	kA	18.5	
			Maximum back-up fuse, if the exp location exceed the switching cap	ected short-circuit currents at the installation acity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			A	and an out of our or out of
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000	
Lifespan, electrical	3. 4.0110			
AC-1				
400 V 50/60 Hz	Operations		10000	
410 V 50/60 Hz	Operations		7500	
	Operacions	Ona/h		
Max. operating frequency Total brook time at about aircuit		Ops/h	120	
Total break time at short-circuit		ms	< 10	
Terminal canacity		0		
Terminal capacity Standard equipment			Screw connection	

			connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
1-hole		mm^2	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 50) 2 x (25 - 50)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch	m:-	mm	16 v E
	min.	mm	16 x 5 24 x 8
Control cables	max.	mm	27.4.0
Control Capies		2	1 x (0.75 - 2.5)
		mm ²	2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

In	Α	300
P _{vid}	W	83.7
	°C	-25
	°C	70
		Meets the product standard's requirements.
		Meets the product standard's requirements.
		Meets the product standard's requirements.
	I _n P _{vid}	P _{vid} W °C


10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must lobserved.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

Rated voltage Rated voltage Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Overload release current setting AD	protection (eci@ss10.0.1-2/-3/-04-09 [AJZ/16013])		
Rated short-circuit breaking capacity lou at 400 V, 50 Hz Overload release current setting Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A Sasa Built-in device fixed built-in technique No Adjustment range undelayed short-circuit release Apicter (see yes Apicter (see yes) Another device fixed built-in technique Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another of auxiliary contacts as change-over contact Apicter (see yes) Another	Rated permanent current lu	Α	300
Overload release current setting A 240 - 3000 Adjustment range short-term delayed short-circuit release A 0 - 0 Adjustment range undelayed short-circuit release A 5 - 8.3 Integrated earth fault protection No Screw connection Type of electrical connection of main circuit Emittin device fixed built-in technique Device construction Built-in device fixed built-in technique Suitable for DIN rail (top hat rail) mounting No Number of auxiliary contacts as normally closed contact Yes Number of auxiliary contacts as change-over contact 0 With switched-off indicator No With under voltage release No Number of poles 4 Position of connection for main current circuit Front side Type of control element Rocker lever Complete device with protection unit Yes Motor drive integrated No Motor drive optional Yes	Rated voltage	V	440 - 440
Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A 5 - 8.3 No Screw connection Yope of electrical connection of main circuit Device construction Built-in device fixed built-in technique Built-in device fixed built-in technique No No No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release Number of poles No No No No No No No No No N	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	25
Adjustment range undelayed short-circuit release Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional	Overload release current setting	Α	240 - 300
Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of poles Number of poles Number of poles Number of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional	Adjustment range short-term delayed short-circuit release	Α	0 - 0
Type of electrical connection of main circuit Device construction Built-in device fixed built-in technique No DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator No With under voltage release No No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional	Adjustment range undelayed short-circuit release	Α	5 - 8.3
Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of indicator No No No No No Number of poles A Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated No Motor drive optional	Integrated earth fault protection		No
Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact No	Type of electrical connection of main circuit		Screw connection
DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No Number of poles Aposition of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional Yes Yes No No No No No No No No No N	Device construction		Built-in device fixed built-in technique
Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No No Number of poles 4 Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O Acceptable Acceptable No No Motor drive optional	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O O O O O O O O O O O O O	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact With switched-off indicator No With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O No No No No No No No No No	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional No No No No No No No No No Yes	Number of auxiliary contacts as normally open contact		0
With under voltage release No Number of poles 4 Position of connection for main current circuit Type of control element Complete device with protection unit Wotor drive optional No	Number of auxiliary contacts as change-over contact		0
Number of poles 4 Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional 4 Front side Rocker lever Rocker lever Yes No Yes	With switched-off indicator		No
Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional Front side Rocker lever Yes No Yes	With under voltage release		No
Type of control element Complete device with protection unit Motor drive optional Rocker lever Yes No Yes	Number of poles		4
Complete device with protection unit Yes Motor drive integrated Motor drive optional Yes	Position of connection for main current circuit		Front side
Motor drive integrated No Motor drive optional Yes	Type of control element		Rocker lever
Motor drive optional Yes	Complete device with protection unit		Yes
	Motor drive integrated		No
Degree of protection (IP)	Motor drive optional		Yes
	Degree of protection (IP)		IP20

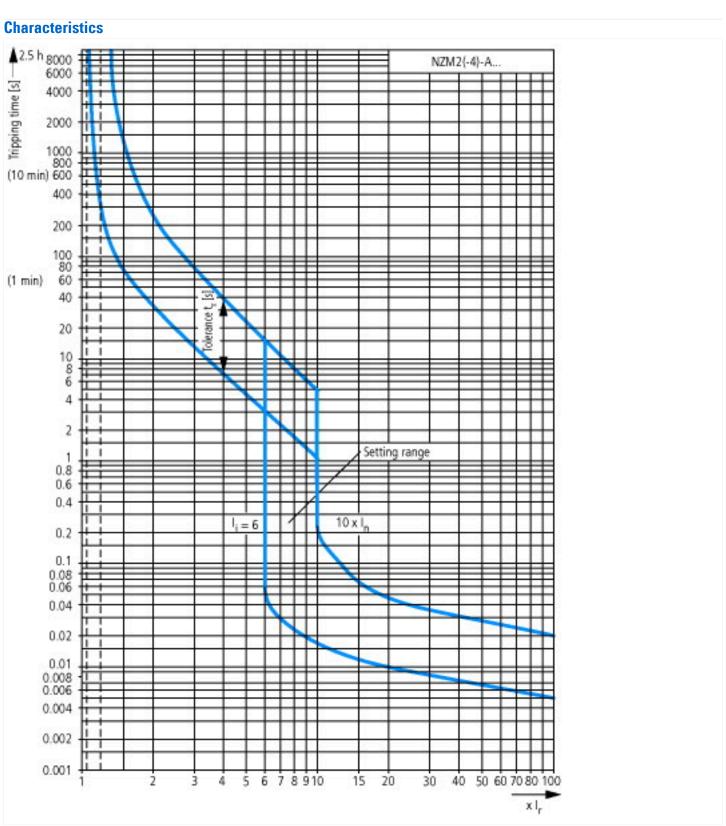


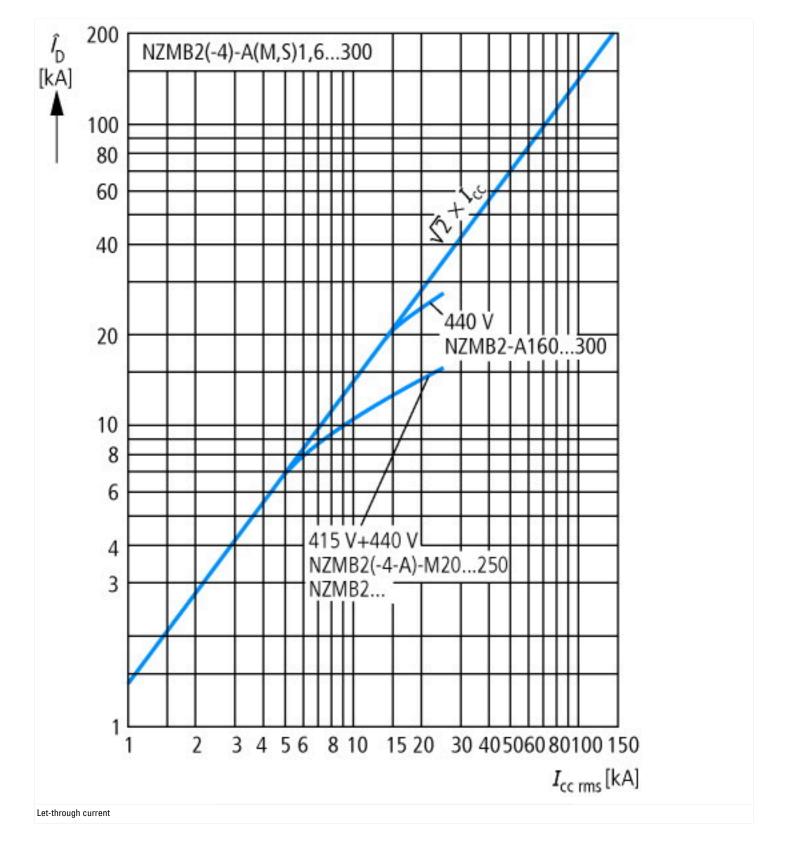


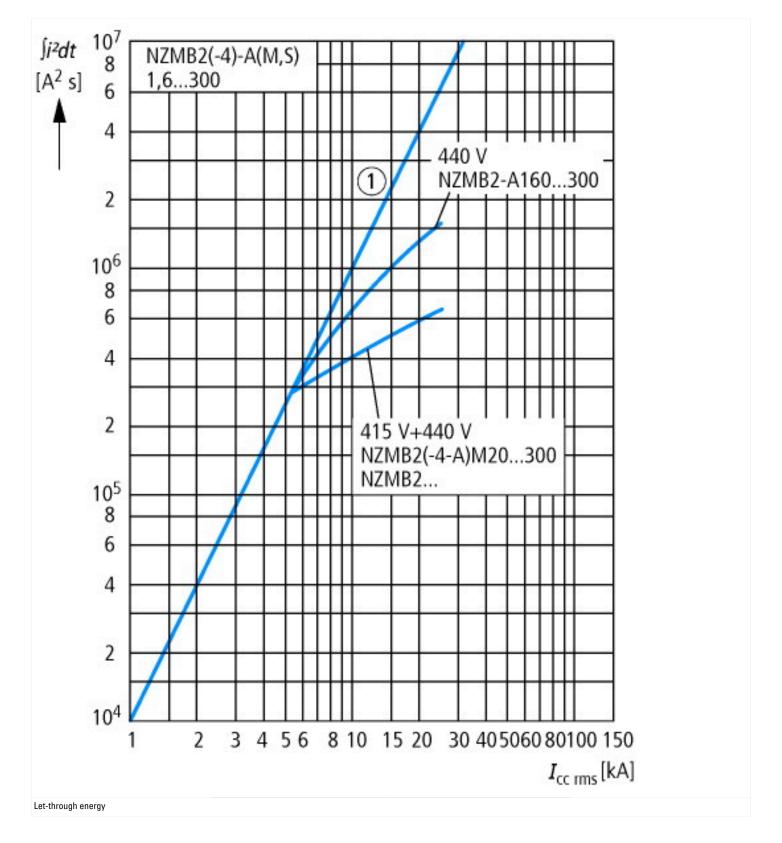

03/16/2020

Dimensions

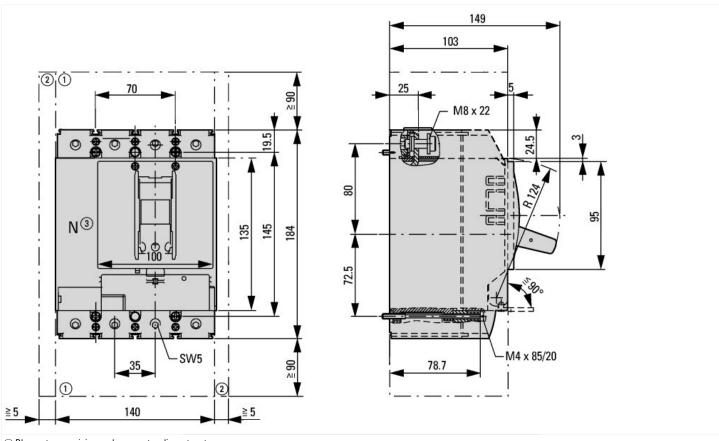

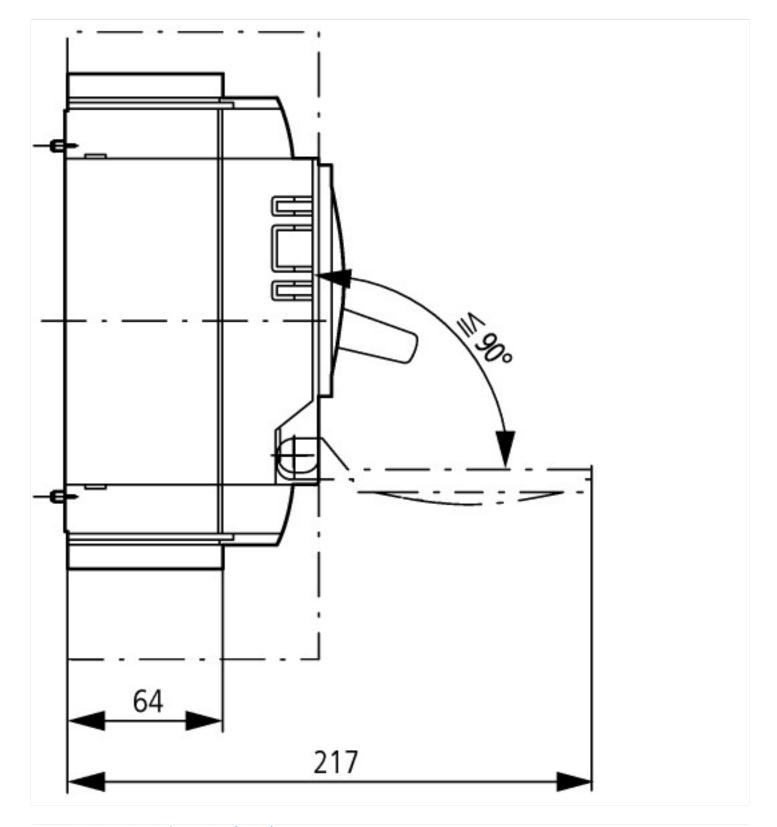

Additional product information (links)

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm
additional technical information for NZM power switch	ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf