DATASHEET - NZMH2-A200-FIA30-BT



Circuit-breaker, 3p, 200A, box terminals, +residual current circuit-breaker, 30mA, AC/DC sensitive $\,$

Powering Business Worldwide*

Part no. NZMH2-A200-FIA30-BT Catalog No. 116305

Similar to illustration			
Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection, fire protection, personnel protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Thermomagnetic release, AC/DC sensitive earth-fault release
Construction size			NZM2
Description			For equipment with power electronics, such as inverters and variable frequency drives Ready-to-connect combination consisting of type B circuit-breaker and residual current circuit-breaker and type A passive section Suitability for the application in three-phase systems without neutral conductor Personnel protection and preventive fire protection for 0 - 100 kHz fault current frequency Operational voltage range Type B 50 - 400 V AC (+ 10 %) Type A functionality even without operational voltage for rated frequency of 50 Hz Not UL/CSA approved Adjusting buttons can be sealed. Rated operating voltage 400 V AC (+/- 10 %) Rated frequency 50 Hz Rated fault current I_n = 0.03 A Depending on the cable manufacturer up to 240 mm² can be connected
Number of poles			3 pole
Standard equipment			Box terminal
Rated operational voltage	Ue	V AC	400
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	150
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	200
Setting range			
Overload trip			
中	l _r	Α	160 - 200
Short-circuit releases			
Non-delayed	$I_i = I_n x \dots$		6 - 10
Short-circuit releases	I _{rm}	A	1200 - 2000

Technical data

General	
Standards	IEC/EN 60947, VDE 0660, EN 62423: Type B
Protection against direct contact	Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing	Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30

Ambient temperature			
Ambient temperature, storage		°C	- 40 - + 70
Operation		°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC		g	20 (half-sinusoidal shock 20 ms)
60068-2-27		9	20 (Half Shidoudi Shock 20 His)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts		V AC	500
between the auxiliary contacts		V AC	300
Weight		kg	2.345
Mounting position			Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			bottom
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	200
Rated surge voltage invariability	U_{imp}		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	U _e	V AC	690
Overvoltage category/pollution degree			III/3
Rated insulation voltage	Ui	V	1000
Use in unearthed supply systems		V	≦ 690
Switching capacity Rated short-circuit making capacity			
	I _{cm}	I. A	200
240 V 400/415 V	I _{cm}	kA	330
	I _{cm}	kA	330
440 V 50/60 Hz	I _{cm}	kA	286
525 V 50/60 Hz	I _{cm}	kA	105
690 V 50/60 H	Ic	kA	40
Rated short-circuit breaking capacity I _{cn}	I _{cn}		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	450
240 V 50/60 Hz	I _{cu}	kA	150
400/415 V 50/60 Hz	I _{cu}	kA	150
440 V 50/60 Hz	I _{cu}	kA	130
525 V 50/60 Hz	I _{cu}	kA	50
690 V 50/60 Hz	I _{cu}	kA	20
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA	
240 V 50/60 Hz	I _{cs}	kA	150
400/415 V 50/60 Hz	Ics	kA	150
440 V 50/60 Hz	I _{cs}	kA	130
525 V 50/60 Hz	I _{cs}	kA	37.5

			Maximum back-up fuse, if the expected short-circuit currents at the installation
Rated short-time withstand current			location exceed the switching capacity of the circuit-breaker.
t = 0.3 s		kA	1.9
	I _{cw}		
t=1s	I _{cw}	kA	1.9
Utilization category to IEC/EN 60947-2			Α
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
AC3	0		0500
400 V 50/60 Hz	Operations		6500
415 V 50/60 Hz	Operations		6500
690 V 50/60 Hz	Operations	0 "	5000
Max. operating frequency		Ops/h	120
Total break time at short-circuit Terminal capacity		ms	< 10
Standard equipment			Box terminal
Optional accessories			Screw terminal
			Tunnel terminal
David access and other			connection on rear
Round copper conductor			
Box terminal		2	1(4040)
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			
Solid		mm ²	1 x 16
Stranded			
1-hole		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16)
50.10		mm	2 x (6 - 16)
Stranded		mm^2	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			2 \(\lambda \(\lambda \) 2 \(\lambda \) \(\lambda \)
Tunnel terminal			
Solid		2	1 x 16
		mm ²	1 / 1
Stranded		2	1 v /25 195\
Stranded		mm ²	1 x (25 - 185)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	$10 \times 16 \times 0.8$ (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 x 5
	max.	mm	24 x 8

Control cables		
	mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

2001gii 1011110441011 40 poi 120, 211 01 100			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	200
Equipment heat dissipation, current-dependent	P _{vid}	W	48
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Α	200
V	690 - 690
kA	150
Α	160 - 200
Α	0 - 0
Α	1200 - 2000
	No
	Frame clamp
	Built-in device fixed built-in technique
	No
	Yes
	0
	0
	0
	V kA A


With switched-off indicator	No
With under voltage release	No
Number of poles	3
Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20

Characteristics

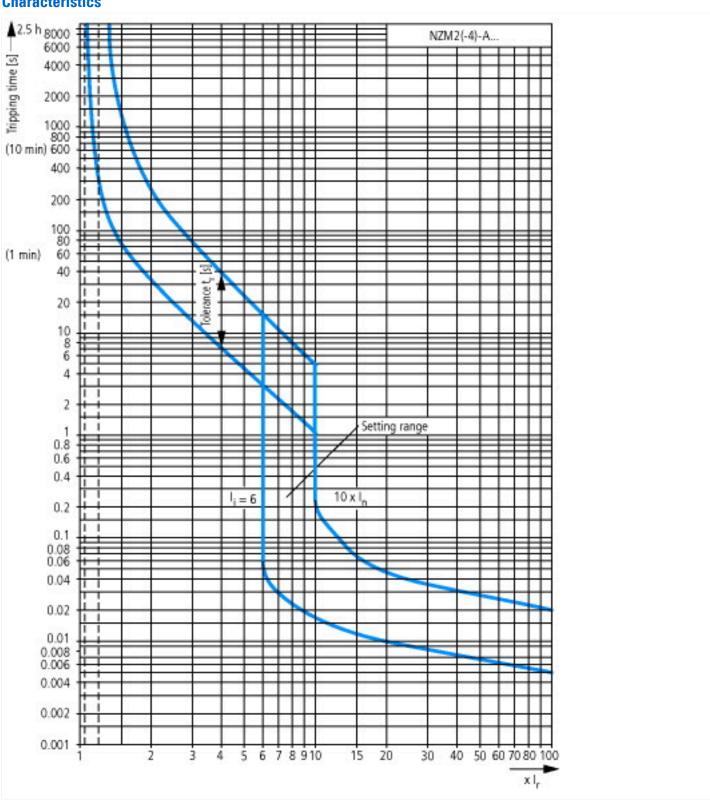


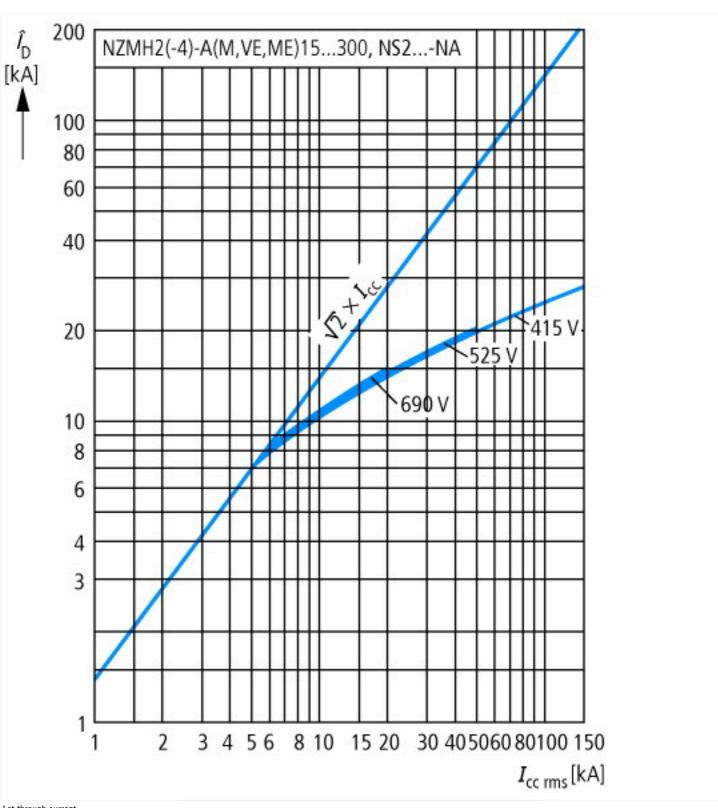


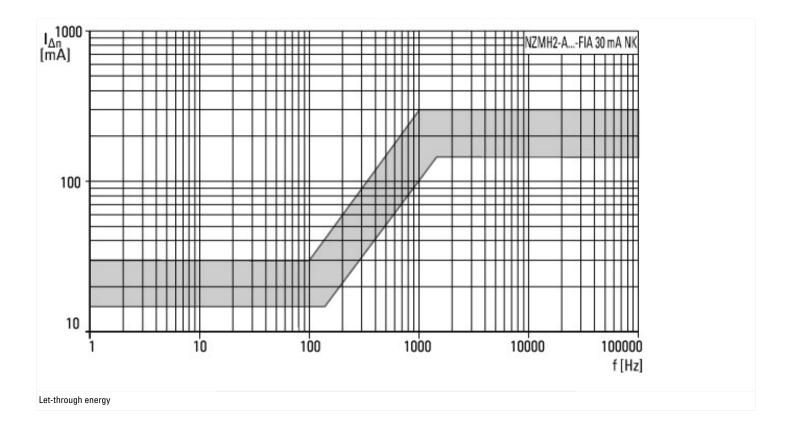

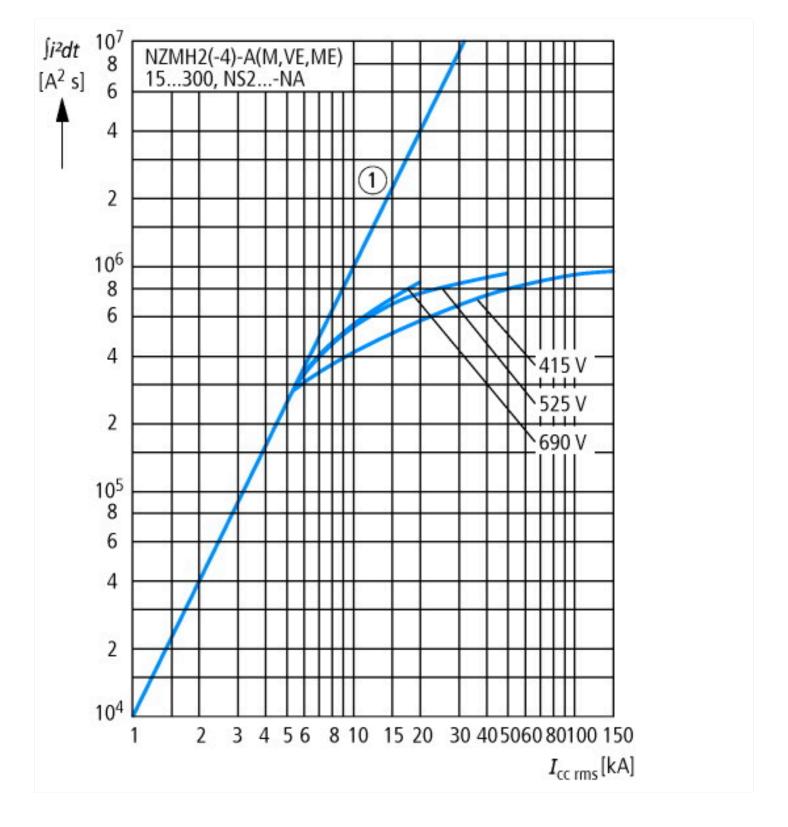

Dimensions

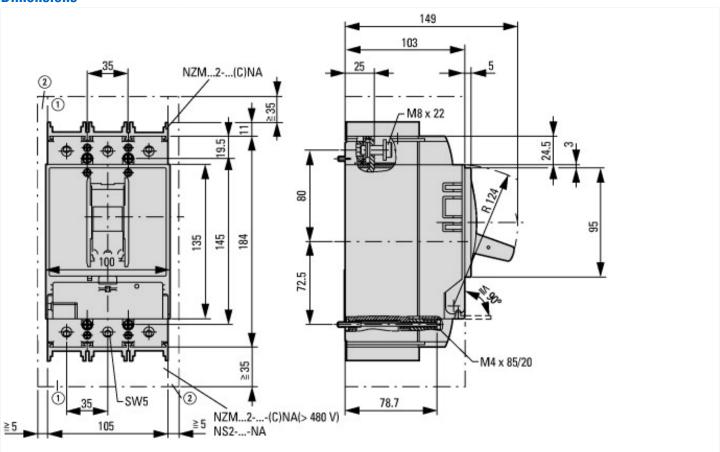

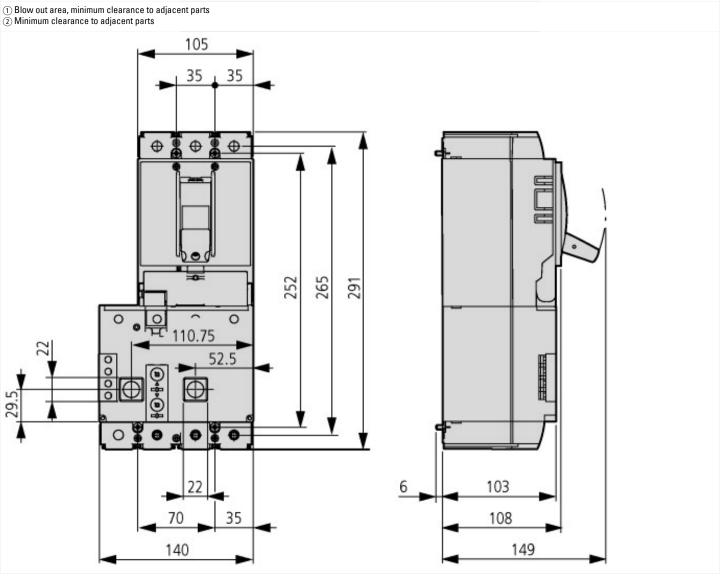

Additional product information (links)

IL01219040Z Residual current device with 3 po	ole NZM2, AC/DC
IL01219040Z Residual current device with 3 pole NZM2, AC/DC	ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01219040Z2017_03.pdf
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.linear. In the content of the cont
additional technical information for NZM power switch	ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf

10 / 10