### **DATASHEET - NZMH2-4-A200-SVE**



Circuit-breaker, 4p, 200A, plug-in module

Part no. NZMH2-4-A200-SVE Catalog No. 113382

EL-Nummer (Norway)

0004357061



Similar to illustration


**Delivery program** 

Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
Installation type			Plug-in units
Release system			Thermomagnetic release
Construction size			NZM2
Description			Set value in neutral conductor is synchronous with set value Ir of main pole.
Number of poles			4 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I <sub>cu</sub>	kA	150
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	200
Neutral conductor	% of phase conductor	CSA	100
Setting range			
Overload trip			
中	l <sub>r</sub>	Α	160 - 200
Main pole	I <sub>r</sub>	A	160 - 200
Short-circuit releases			
Non-delayed	$I_i = I_n x \dots$		6 - 10

#### **Technical data**

General

General			
Standards			IEC/EN 60947
Protection against direct contact			Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Ambient temperature, storage	c	°C	- 40 - + 70
Operation	c	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	(	9	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts	\	V AC	500
between the auxiliary contacts	\	V AC	300
Weight	ŀ	kg	3.5
Mounting position			Vertical and 90° in all directions



With XFI earth-fault release:
- NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit
- NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit:
- NZM3, N3: vertical, 90° right/left
- NZM4, N4: vertical

with remote operator:
- NZM2, N(S)2, NZM3, N(S)3,
NZM4, N(S)4: vertical and 90° in all directions

Direction of incoming supply	as required
Degree of protection	
Device	In the operating controls area: IP20 (basic degree of protection)
Enclosures	With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations	Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)	Temperature dependency, Derating
Circuit-breakers	

Rated current = rated uninterrupted current	$I_n = I_u$	Α	200
Rated surge voltage invariability	$U_{imp}$		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	U <sub>e</sub>	V AC	690
Overvoltage category/pollution degree			III/3
Rated insulation voltage	Ui	V	1000
Use in unearthed supply systems		V	≦ 690

400 V 50/60 Hz

Switching capacity			
Rated short-circuit making capacity	I <sub>cm</sub>		
240 V	I <sub>cm</sub>	kA	330
400/415 V	I <sub>cm</sub>	kA	330
440 V 50/60 Hz	I <sub>cm</sub>	kA	286
525 V 50/60 Hz	I <sub>cm</sub>	kA	105
690 V 50/60 H	Ic	kA	40
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	
240 V 50/60 Hz	Icu	kA	150
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	150
440 V 50/60 Hz	I <sub>cu</sub>	kA	130
525 V 50/60 Hz	I <sub>cu</sub>	kA	50
690 V 50/60 Hz	I <sub>cu</sub>	kA	20
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA	
240 V 50/60 Hz	I <sub>cs</sub>	kA	150
400/415 V 50/60 Hz	Ics	kA	150
440 V 50/60 Hz	I <sub>cs</sub>	kA	130
525 V 50/60 Hz	I <sub>cs</sub>	kA	37.5
690 V 50/60 Hz	I <sub>cs</sub>	kA	5
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current			
t = 0.3 s	I <sub>cw</sub>	kA	1.9
t=1 s	I <sub>cw</sub>	kA	1.9
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			

Operations

10000

690 V 50/60 Hz 0 AC3 400 V 50/60 Hz 0 415 V 50/60 Hz 0		Ops/h	10000 7500 6500 6500 5000 120 < 10
AC3  400 V 50/60 Hz  0  415 V 50/60 Hz  0  690 V 50/60 Hz  0  Max. operating frequency  Total break time at short-circuit  Terminal capacity  Standard equipment	Operations Operations Operations	Ops/h	6500 6500 5000
400 V 50/60 Hz  415 V 50/60 Hz  690 V 50/60 Hz  0  Max. operating frequency  Total break time at short-circuit  Terminal capacity  Standard equipment	) perations Operations	Ops/h	6500 5000 120
415 V 50/60 Hz 0 690 V 50/60 Hz 0 Max. operating frequency Total break time at short-circuit Terminal capacity Standard equipment	) perations Operations	Ops/h	6500 5000 120
690 V 50/60 Hz  Max. operating frequency  Total break time at short-circuit  Terminal capacity  Standard equipment	perations	Ops/h	5000
Max. operating frequency  Total break time at short-circuit  Terminal capacity  Standard equipment		Ops/h	120
Total break time at short-circuit  Terminal capacity  Standard equipment			
Terminal capacity Standard equipment		IIIS	< 10
Standard equipment			
			Screw connection
			NZM2-4-XSVS
Optional accessories			Box terminal
			Tunnel terminal connection on rear
Round copper conductor			0011100110110111011
Box terminal			
Solid		mm <sup>2</sup>	1 x (10 - 16)
		111111	2 x (6 - 16)
Stranded			1 x (25 - 185) 2 x (25 - 70)
Tunnel terminal			2 X (23 - 70)
Solid		2	1 x 16
		mm <sup>2</sup>	1 X 10
Stranded			
1-hole		mm <sup>2</sup>	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid			1 x (10 - 16) 2 x (6 - 16)
Stranded		mm <sup>2</sup>	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm <sup>2</sup>	1 x 16
Stranded			
Stranded		mm <sup>2</sup>	1 x (25 - 185)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
m	nin.	mm	2 x 9 x 0.8
п	nax.		10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	nin.	mm	2 x 16 x 0.8
Flat copper strip, with holes	nax.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	nm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
m	nin.	mm	16 x 5
m	nax.	mm	24 x 8
Control cables			
			1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

# Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	200
Equipment heat dissipation, current-dependent	$P_{vid}$	W	48
Operating ambient temperature min.		°C	-25


°C	70
	Meets the product standard's requirements.
	Does not apply, since the entire switchgear needs to be evaluated.
	Does not apply, since the entire switchgear needs to be evaluated.
	Meets the product standard's requirements.
	Does not apply, since the entire switchgear needs to be evaluated.
	Meets the product standard's requirements.
	Does not apply, since the entire switchgear needs to be evaluated.
	Does not apply, since the entire switchgear needs to be evaluated.
	Is the panel builder's responsibility.
	Is the panel builder's responsibility.
	Is the panel builder's responsibility.
	Is the panel builder's responsibility.
	Is the panel builder's responsibility.
	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
	The device meets the requirements, provided the information in the instruction
	°C


### **Technical data ETIM 7.0**


 $Low-voltage\ industrial\ components\ (EG000017)\ /\ Power\ circuit-breaker\ for\ trafo/generator/installation\ protection\ (EC000228)$ 

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Rated short-circuit breaking capacity Icu at 400 V, 50 Hz  Overload release current setting  Aligo 200  Adjustment range short-term delayed short-circuit release  Aligo 3 - 0  Adjustment range undelayed short-circuit release  Aligo 6 - 10  No  Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  With switched-off indicator  With under voltage release  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  Motor drive optional  Maligorate  Aligo 2-0  Aligo 3 - 0  No  No  Screw connection  No  No  No  Qual Complete device plug-in technique  No  No  Qual Complete device plug-in technique  No  No  Qual Complete device plug-in technique  No  Qual Complete device plug-in tec	protection (ecl@ss10.0.1-2/-3/-04-09 [AJZ/16013])		
Rated short-circuit breaking capacity lou at 400 V, 50 Hz  Overload release current setting  Aligoutment range short-term delayed short-circuit release  Aligoutment range undelayed short-circuit release  Aligou	Rated permanent current lu	Α	200
Overload release current setting Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A 6-10 No Type of electrical connection of main circuit Device construction Built-in device plug-in technique Built-in device plug-in technique Built-in device plug-in technique Abjustment rail mounting optional Number of auxiliary contacts as normally closed contact Abjustment rail mounting optional Abjustment rai	Rated voltage	V	690 - 690
Adjustment range short-term delayed short-circuit release Adjustment range undelayed sont-circuit r	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	150
Adjustment range undelayed short-circuit release A 6 - 10 Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release Number of poles Position of connection for main current circuit Type of element Complete device with protection unit Motor drive integrated Motor drive integrated Motor drive optional	Overload release current setting	А	160 - 200
Integrated earth fault protection Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional  No  No  No  No  No  No  No  No  No  N	Adjustment range short-term delayed short-circuit release	А	0 - 0
Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  No  No  No  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional	Adjustment range undelayed short-circuit release	Α	6 - 10
Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of poles  No  No  No  No  No  No  No  No  No  N	Integrated earth fault protection		No
Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of polaxiliary contacts as change-over contact No No No No Notor drive integrated No No No Notor drive optional	Type of electrical connection of main circuit		Screw connection
DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With under voltage release  No  Number of poles  Acceptable  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  Yes  Yes  Yes  No  No  No  No  No  No  No  No  No  N	Device construction		Built-in device plug-in technique
Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With under voltage release  No  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  O  No  No  No  No  No  No  No  No	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  No With switched-off indicator  With under voltage release  No No Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  O  O  No	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact  With switched-off indicator  With under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  O  O  O  O  O  O  O  O  O  O  O  O	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator  With under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  No  No  No  No  No  No  No  Yes	Number of auxiliary contacts as normally open contact		0
With under voltage release  No  Number of poles  4  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  No  No  No  No  No  No  No  No  Yes	Number of auxiliary contacts as change-over contact		0
Number of poles  4 Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  4  Front side  Rocker lever  Rocker lever  Yes  Motor drive optional  4  Front side  Rocker lever  Rocker lever  Yes  Motor drive optional  4  Front side  Rocker lever  Rocker lever  Yes	With switched-off indicator		No
Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  Front side  Rocker lever  Yes  No  Yes	With under voltage release		No
Type of control element Complete device with protection unit Motor drive optional  Rocker lever  Yes  No  Yes	Number of poles		4
Complete device with protection unit  Yes  Motor drive integrated  No  Motor drive optional  Yes	Position of connection for main current circuit		Front side
Motor drive integrated No Yes	Type of control element		Rocker lever
Motor drive optional Yes	Complete device with protection unit		Yes
	Motor drive integrated		No
Degree of protection (IP) IP20	Motor drive optional		Yes
	Degree of protection (IP)		IP20

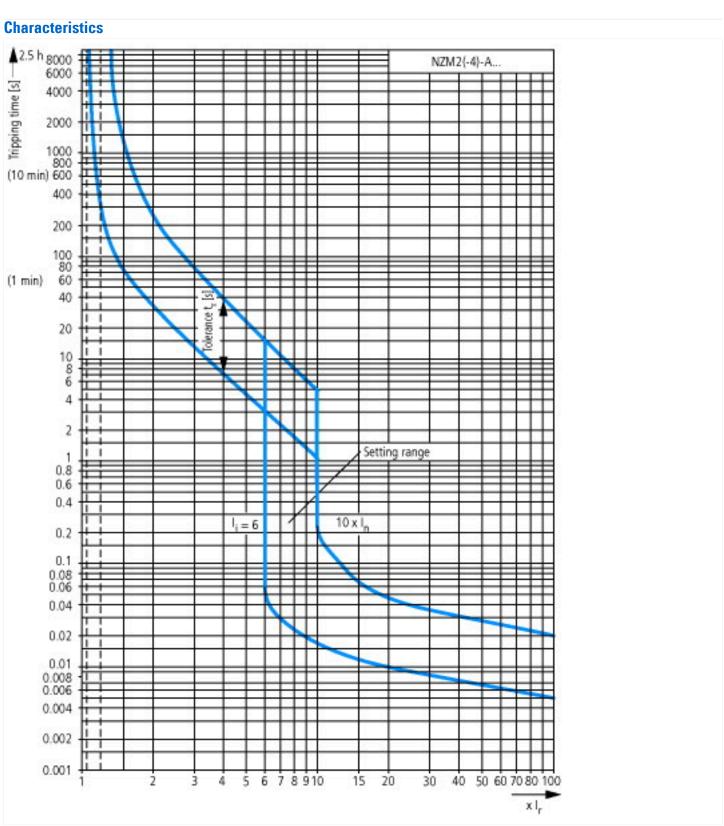


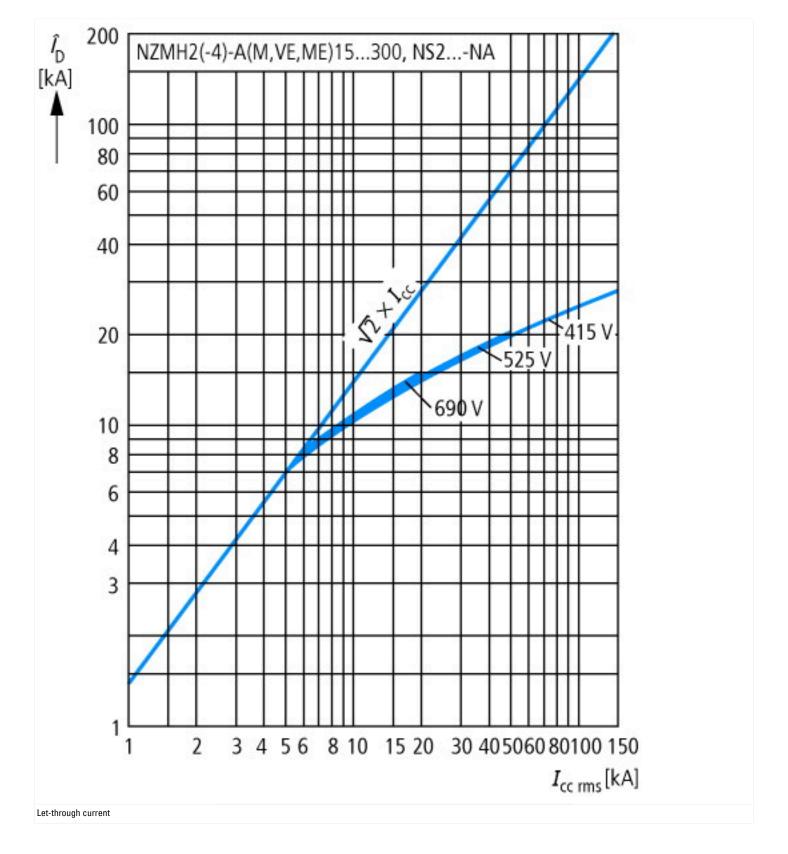

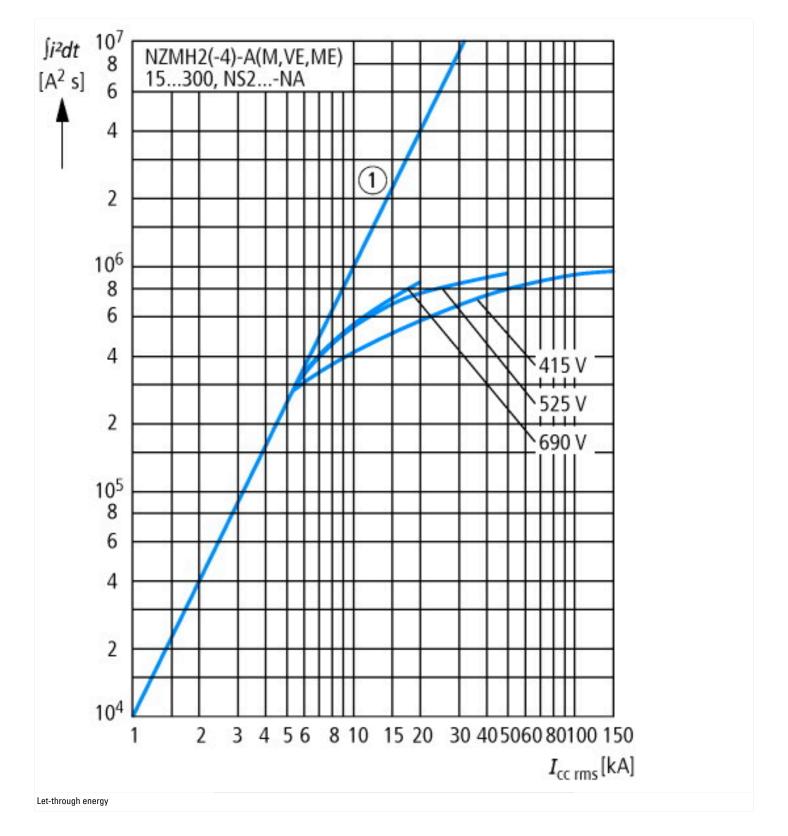

# **Dimensions**

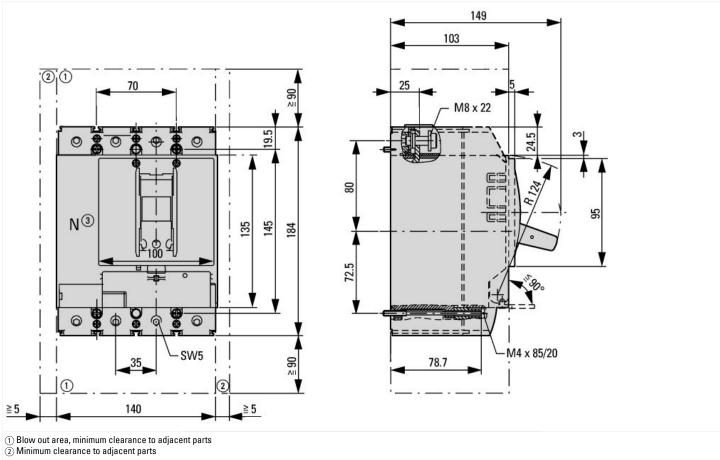

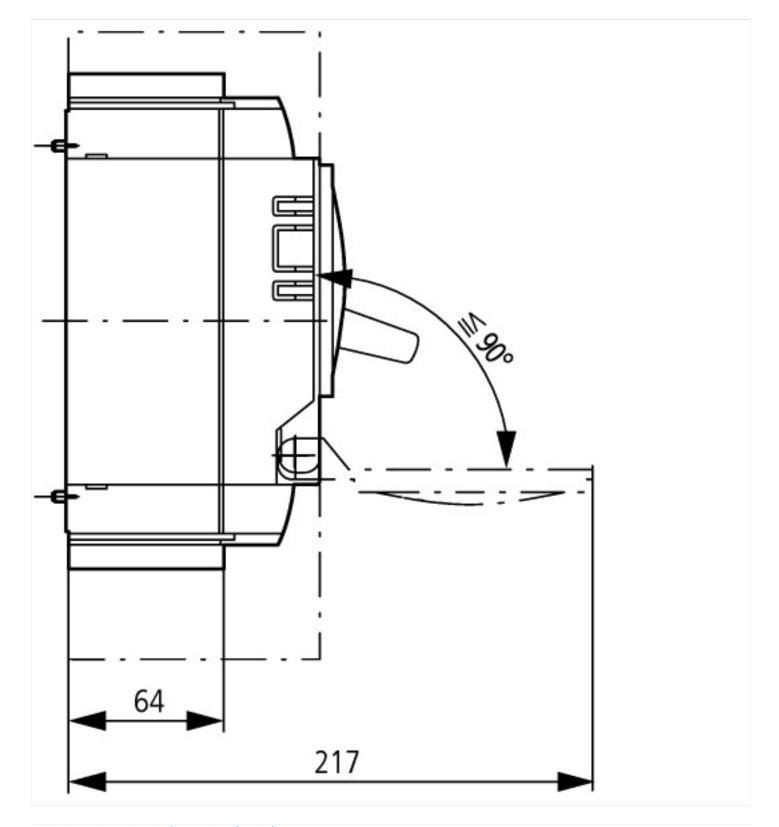

# Additional product information (links)

Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm
additional technical information for NZM power switch	ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf