



**Radio interference suppression filter, three-phase, ULN= max. 520 + 10% V, 75 A, For use with: DA1**

**Part no. DX-EMC34-075-FS5**  
**Catalog No. 172284**  
**Alternate Catalog No. DX-EMC34-075-FS5**  
**EL-Nummer (Norway) 4110045**

### Delivery program

|                           |                 |    |  |
|---------------------------|-----------------|----|--|
| Description               |                 |    | three-phase  |
| Mains voltage (50/60Hz)   | U <sub>LN</sub> | V  | max. 520 + 10%                                     |
| Rated operational current | I <sub>e</sub>  | A  | 75   |
| For use with              |                 |    | DA1  |
| Degree of Protection      |                 |    | IP00<br>IP20 when connected                        |
| Connection type           |                 |    | Connection terminal, PE stud, prefabricated cables |
| Weight                    | m               | kg | 10   |
| Notes                     |                 |    | Base-mounted filter, side-mounting filter          |

### Technical data

#### General

|                          |  |   |   |
|--------------------------|--|---|---|
| Standards                |  |   | EN 50178, IEC 61800-3, EN 61800-3 incl. A11               |
| Environmental conditions |  |   |   |
| Altitude                 |  | m | Up to 2000 m a.s.l.; observe derating at higher altitudes |
| Degree of Protection     |  |   | IP00<br>IP20 when connected                               |

### Design verification as per IEC/EN 61439


|  |  |  |  |
|--|--|--|--|
| Technical data for design verification   |  |  |  |
| Degree of Protection   |  |  | IP20   |
| IEC/EN 61439 design verification   |  |  |  |
| 10.2 Strength of materials and parts   |  |  |  |
| 10.2.2 Corrosion resistance  |  |  | Meets the product standard's requirements.   |
| 10.2.3.1 Verification of thermal stability of enclosures   |  |  | Meets the product standard's requirements.   |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |  |  | Meets the product standard's requirements.   |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |  |  | Meets the product standard's requirements.   |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |  |  | Meets the product standard's requirements.   |
| 10.2.5 Lifting   |  |  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.6 Mechanical impact   |  |  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.7 Inscriptions  |  |  | Meets the product standard's requirements.   |
| 10.3 Degree of protection of ASSEMBLIES  |  |  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.4 Clearances and creepage distances   |  |  | Meets the product standard's requirements.   |
| 10.5 Protection against electric shock   |  |  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.6 Incorporation of switching devices and components   |  |  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.7 Internal electrical circuits and connections  |  |  | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors   |  |  | Is the panel builder's responsibility.   |
| 10.9 Insulation properties   |  |  |  |
| 10.9.2 Power-frequency electric strength   |  |  | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage   |  |  | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material   |  |  | Is the panel builder's responsibility.   |
| 10.10 Temperature rise   |  |  | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating   |  |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |

|                                     |  |  |
|-------------------------------------|--|--|
| 10.12 Electromagnetic compatibility |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.13 Mechanical function           |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

### Technical data ETIM 7.0

|   |        |
|---|--------|
| Low-voltage industrial components (EG000017) / Accessories for frequency controller (EC002025)  |        |
| Electric engineering, automation, process control engineering / Electrical drive / Static frequency converter / Static frequency converter (accessory) (ecl@ss10.0.1-27-02-31-92 [AFR303003]) |        |
| Type of accessory   | Filter |

### Dimensions

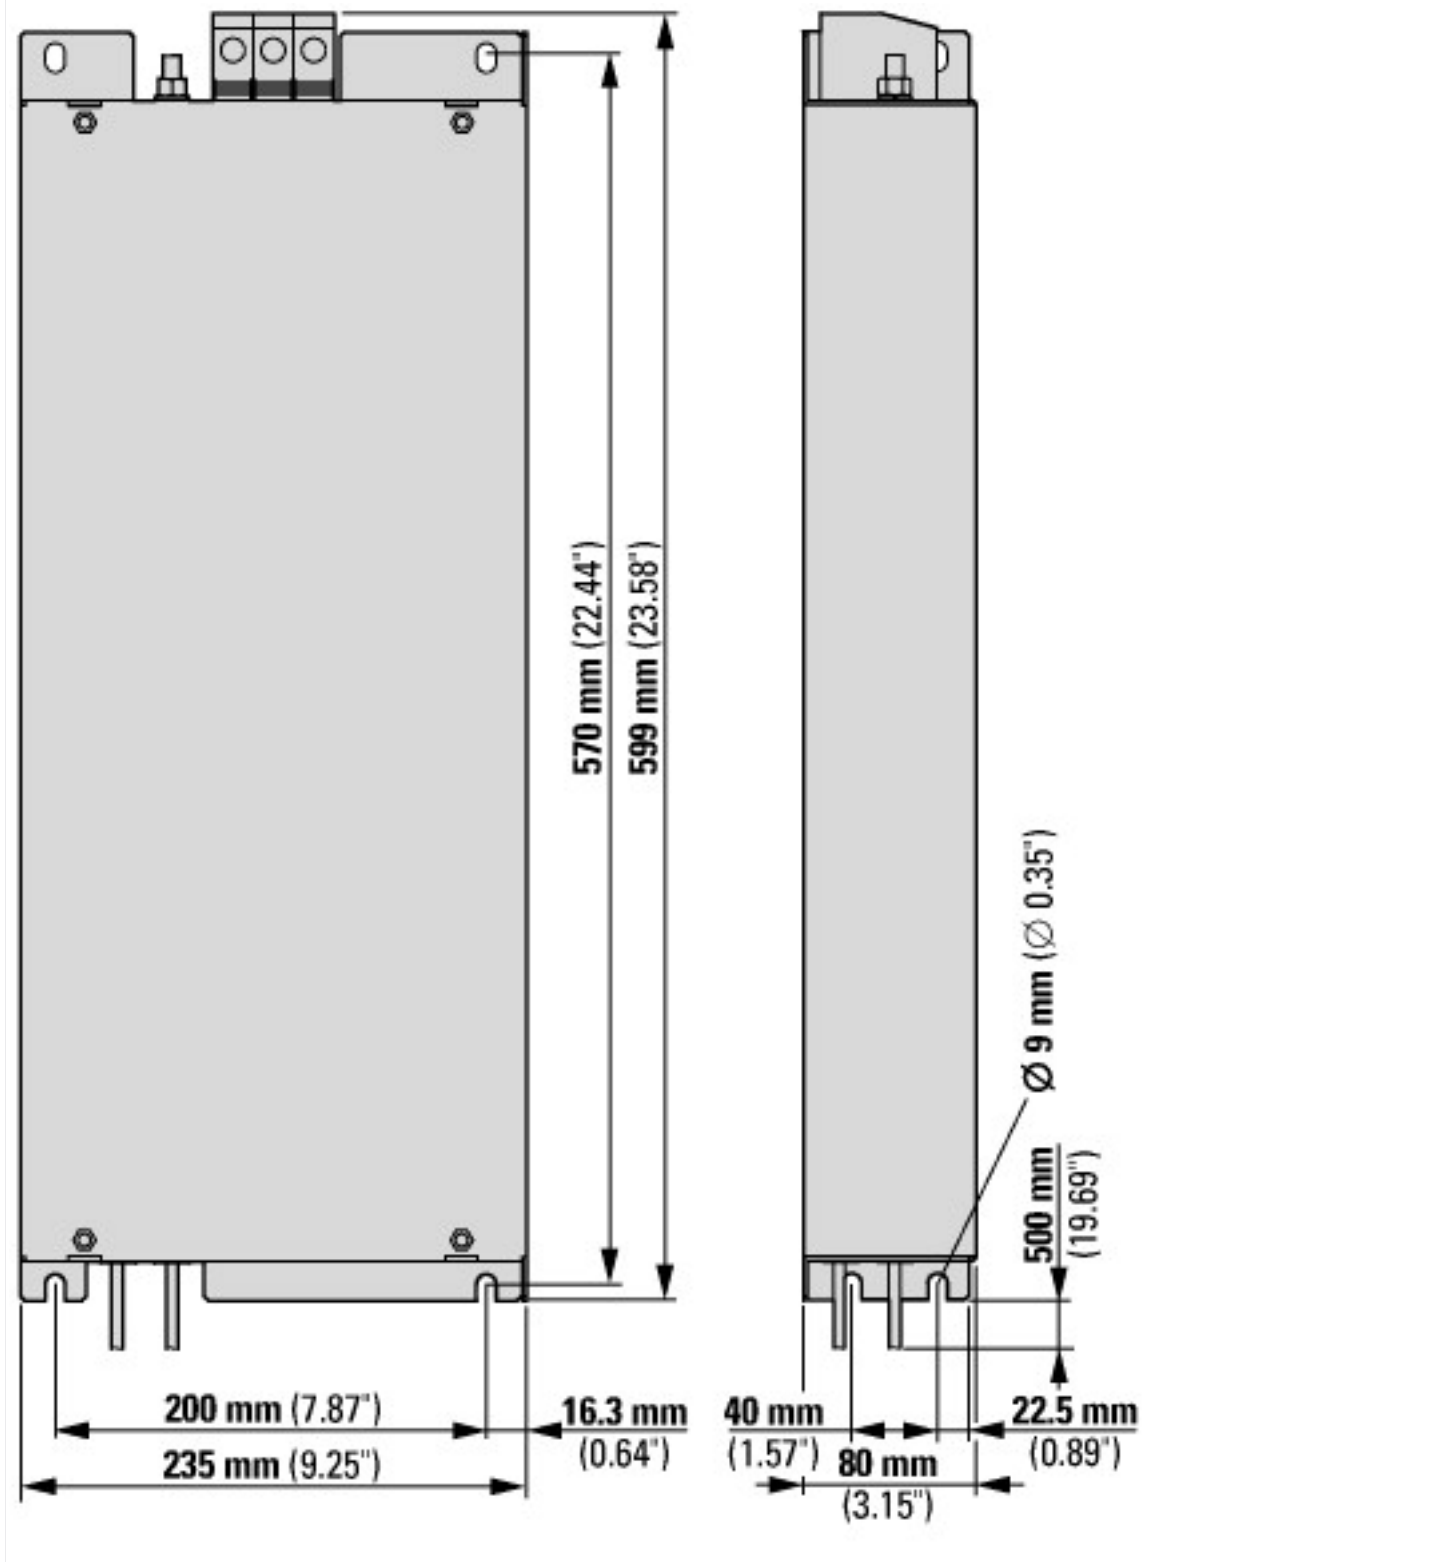

## Assets (links)

### Instruction Leaflets

IL04012017Z2018\_05

## Additional product information (links)

### IL04012017Z\*.pdf EMC filter

IL04012017Z\*.pdf EMC filter

[ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL04012017Z2018\\_05.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL04012017Z2018_05.pdf)

CA04020001Z-EN Product Range Catalog:  
Efficient Engineering for Starting and  
Controlling Motors

[http://www.eaton.eu/DE/ecm/groups/public/@pub/@europe/@electrical/documents/content/pct\\_1095238.pdf](http://www.eaton.eu/DE/ecm/groups/public/@pub/@europe/@electrical/documents/content/pct_1095238.pdf)