DATASHEET - DILER-31-C(115V60HZ)



Contactor relay, 115V 60 Hz, N/O = Normally open: 3 N/O, N/C = Normally closed: 1 NC, Spring-loaded terminals, AC operation



Part no. DILER-31-C(115V60HZ)

Catalog No. 231816

Alternate Catalog XTRMC10A31CX

No

| _ | | | |
|------|--------|----------|---|
| ומוו | IVORV | program | ì |
| UG | IIVEIV | vivuiaii | ı |

| Delivery program | | | |
|---|----------------|---|---|
| Product range | | | DILER Mini-contactors |
| Application | | | Contactor relays |
| Description | | | with interlocked opposing contacts |
| Connection technique | | | Spring-loaded terminals |
| Rated operational current | | | |
| Conventional free air thermal current, 1 pole | | | |
| Open | | | |
| at 50 °C | $I_{th} = I_e$ | Α | 10 |
| AC-15 | | | |
| 220 V 230 V 240 V | Ie | Α | 6 |
| 380 V 400 V 415 V | Ie | Α | 3 |
| Contacts | | | |
| N/O = Normally open | | | 3 N/O |
| N/C = Normally closed | | | 1 NC |
| Contact sequence | | | A1 13 21 33 43 1 A2 14 22 34 44 |
| Code number and version of combination | | | |
| Distinctive number | | | 31E |
| For use with | | | DILE-C |
| Actuating voltage | | | 115V 60 Hz |
| Voltage AC/DC | | | AC operation |
| Instructions | | | Contact numbers to EN 50011 Coil terminal markings to EN 50005 |

Technical data

General

| Standards | | | IEC/EN 60947, EN 60947-5-1, VDE 0660, UL, CSA |
|-----------------------------|--------------|-------------------|--|
| Lifespan, mechanical | | | |
| AC operated | Operations | x 10 ⁶ | 10 |
| Maximum operating frequency | Operations/h | | 9000 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Open | | °C | -25 - +50 |
| Enclosed | | °C | - 25 - 40 |
| Mounting position | | | |
| Mounting position | | | As required, except vertical with terminals A1/A2 at the bottom |

| Mounting position | | | |
|---|----------------|-----------------|---|
| Mechanical shock resistance (IEC/EN 60068-2-27) | | | |
| Half-sinusoidal shock, 10 ms | | | |
| Basic unit with auxiliary contact module | | g | |
| N/O contact | | g | 10 |
| N/C contact | | g | 8 |
| Degree of Protection | | | IP20 |
| Protection against direct contact when actuated from front (EN 50274) | | | Finger and back-of-hand proof |
| Altitude | | m | Max. 2000 |
| Weight | | | |
| AC operated | | kg | 0.17 |
| Terminal capacities | | mm ² | |
| Spring-loaded terminals | | | |
| Flexible with or without ferrule DIN 46228 | | mm ² | 1 x (1 - 2.5) |
| | | | 2 x (1 - 2.5) |
| Solid or stranded | | AWG | 1 x (16 - 14) 2 x (16 - 14) |
| Stripping length | | mm | 10 |
| Standard screwdriver | | mm | 0.6 x 3.5 |
| Contacts | | | |
| Interlocked opposing contacts to ZH 1/457, including auxiliary contact module | | | Yes |
| Rated impulse withstand voltage | U_{imp} | V AC | 6000 |
| Overvoltage category/pollution degree | | | 111/3 |
| Rated insulation voltage | Ui | V AC | 690 |
| Rated operational voltage | U _e | V AC | 600 |
| Safe isolation to EN 61140 | | | |
| between coil and auxiliary contacts | | V AC | 300 |
| between the auxiliary contacts | | V AC | 300 |
| Rated operational current | | Α | |
| Conventional free air thermal current, 1 pole | | | |
| Open | | | |
| at 50 °C | $I_{th} = I_e$ | Α | 10 |
| AC-15 | | | |
| 220 V 230 V 240 V | l _e | Α | 6 |
| 380 V 400 V 415 V | l _e | Α | 3 |
| 500 V | l _e | Α | 1.5 |
| DC current | | | |
| Notes | | | Switch-on and switch-off conditions based on DC-13, time constant as specified. |
| DC L/R ≤ 15 ms | | | |
| Contacts in series: | | Α | |
| 1 | 24 V | Α | 2.5 |
| 2 | 60 V | Α | 2.5 |
| 3 | 110 V | Α | 1.5 |
| 3 | 220 V | Α | 0.5 |
| Control circuit reliability | Failure rate | λ | <10 ⁻⁸ , < one failure at 100 million operations (at $U_e = 24 \text{ V DC}$, $U_{min} = 17 \text{ V}$, $I_{min} = 5.4 \text{ mA}$) |

| Maximum overcurrent protective device | | | |
|--|---------|------------------|------------|
| 220 V 230 V 240 V | | PKZM0 | 4 |
| 380 V 400 V 415 V | | PKZM0 | 4 |
| Short-circuit protection maximum fuse | | | |
| 500 V | | A gG/gL | 6 |
| 500 V | | A fast | 10 |
| Current heat loss at I _{th} | | | |
| AC operated | | W | 1.1 |
| lagnet systems | | | |
| oltage tolerance | | | |
| AC operated | | | |
| Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz | Pick-up | x U _c | 0.8 - 1.1 |
| Dual-frequency coil 50/60 Hz | Pick-up | x U _c | 0.85 - 1.1 |
| lower consumption | | | |
| AC operation | | | |
| Single-voltage coil 60 Hz | Pick-up | VA | 25 |
| Single-voltage coil 60 Hz | Sealing | VA | 4.6 |
| Single-voltage coil 60 Hz | Sealing | W | 1.8 |
| uty factor | | % DF | 100 |
| changeover time at 100 % U _S (recommended value) | | | |
| AC operated closing delay | | ms | 14 - 21 |
| AC operated N/O contact opening delay | | ms | 8 - 18 |
| AC operated With auxiliary contact module Max. closing delay | | ms | 45 |
| ating data for approved types | | | |
| Auxiliary contacts | | | |
| Pilot Duty | | | |
| AC operated | | | A600 |
| DC operated | | | P300 |
| General Use | | | |
| AC | | ٧ | 600 |
| AC | | Α | 10 |
| DC | | V | 250 |

Design verification as per IEC/EN 61439

DC

| Technical data for design verification | | | |
|--|-------------------|----|--|
| Rated operational current for specified heat dissipation | In | Α | 6 |
| Heat dissipation per pole, current-dependent | P _{vid} | W | 0.4 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 0 |
| Static heat dissipation, non-current-dependent | P_{vs} | W | 1.8 |
| Heat dissipation capacity | P _{diss} | W | 0 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 50 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| $10.2.3.3 \text{Verification of resistance of insulating materials to abnormal heat} \\ \text{and fire due to internal electric effects}$ | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |

0.5


| 10.4 Clearances and creepage distances | Meets the product standard's requirements. |
|--|--|
| 10.5 Protection against electric shock | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


Technical data ETIM 7.0

| Low-voltage industrial components (EG000017) / Contactor relay (EC000196) | | | | |
|---|---|-------------------------|--|--|
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Contactor relay (ecl@ss10.0.1-27-37-10-01 [AAB716014]) | | | | |
| Rated control supply voltage Us at AC 50HZ | V | 0 - 0 | | |
| Rated control supply voltage Us at AC 60HZ | V | 115 - 115 | | |
| Rated control supply voltage Us at DC | V | 0 - 0 | | |
| Voltage type for actuating | | AC | | |
| Rated operation current le, 400 V | А | 3 | | |
| Connection type auxiliary circuit | | Spring clamp connection | | |
| Mounting method | | DIN-rail/screw | | |
| Interface | | No | | |
| Number of auxiliary contacts as normally closed contact | | 1 | | |
| Number of auxiliary contacts as normally open contact | | 3 | | |
| Number of auxiliary contacts as normally closed contact, delayed switching | | 0 | | |
| Number of auxiliary contacts as normally open contact, leading | | 0 | | |
| With LED indication | | No | | |
| Number of auxiliary contacts as change-over contact | | 0 | | |
| Manual operation possible | | No | | |


Approvals


| Product Standards | IEC/EN 60947-4-1; UL 508; CSA-C22.2 No. 14-05; CE marking |
|--------------------------------------|---|
| UL File No. | E29184 |
| UL Category Control No. | NKCR |
| CSA File No. | 012528 |
| CSA Class No. | 3211-03 |
| North America Certification | UL listed, CSA certified |
| Specially designed for North America | No |

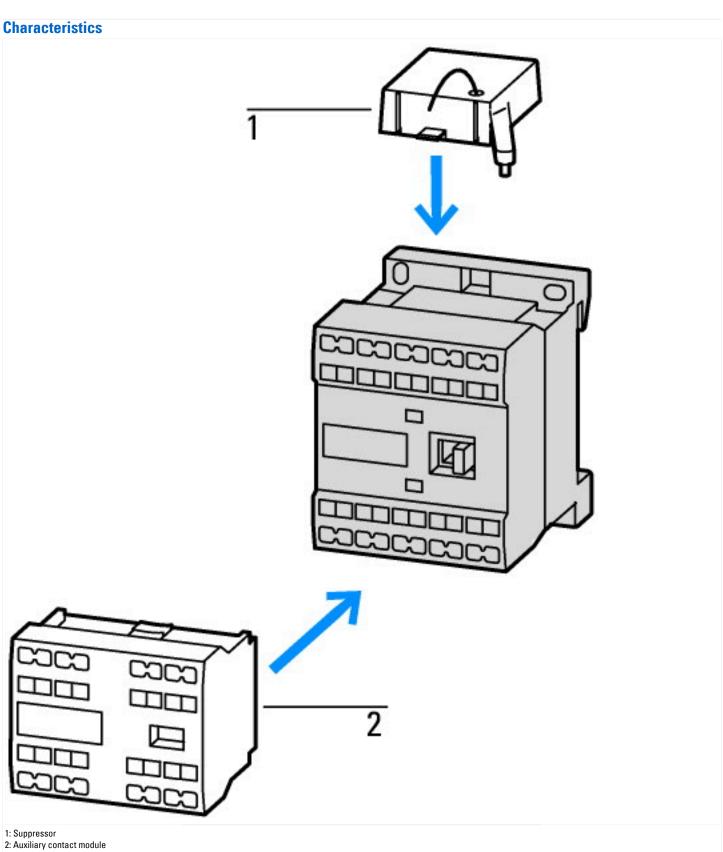

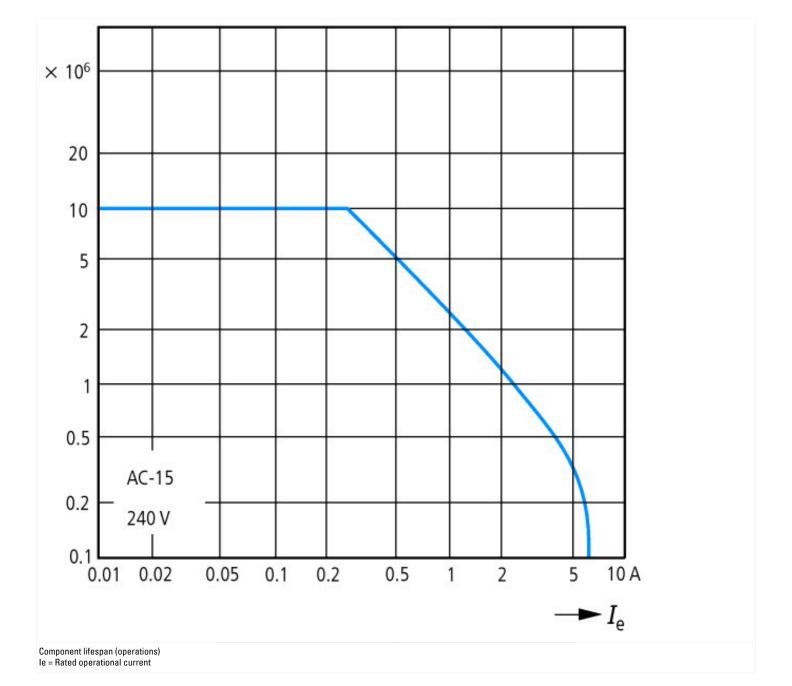

Dimensions

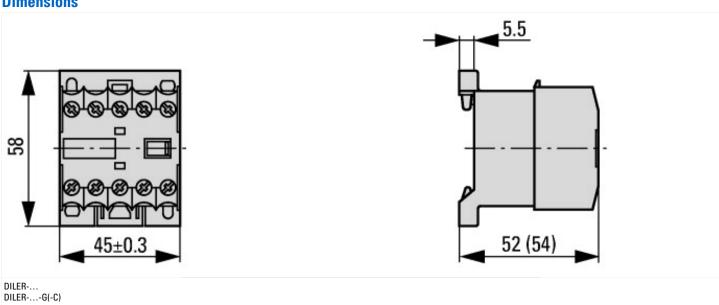

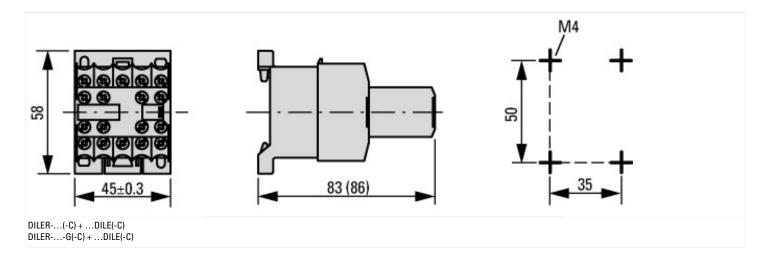

Assets (links)

Declaration of CE Conformity

00003110

Instruction Leaflets

IL03407009Z2018_04

Additional product information (links)

IL03407009Z (AWA2100-0882) Mini contactor relay

IL03407009Z (AWA2100-0882) Mini contactor relay

 $ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03407009Z2020_05.pdf$