# **DATASHEET - NZMS2-PX25-TZ**



NZM2 PXR25 circuit breaker - integrated energy measurement class 1, 25A, 3p, Screw terminal, earth-fault protection and zone selectivity



Part no. NZMS2-PX25-TZ Catalog No. 192147

<b>D</b>		
ומוו	IVATV	program
DEI	IVEIV	ni vui aiii

Delivery program			
Product range			Circuit-breaker
Protective function			Systems, cable, selectivity and generator protection Earth-fault protection Zone selectivity
Standard/Approval			IEC
Installation type			Fixed
Release system			Electronic release
Construction size			NZM2
Description			LSIG overload protection and delayed and non-delayed short-circuit protective device, earth-fault protection Class 1 energy measurement, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Zone selectivity ZSI Interface module in equipment supplied. Optionally communication-capable with internal Modbus RTU module or CAM
Number of poles			3 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I <sub>cu</sub>	kA	70
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	25
Setting range			
Overload trip			
中	I <sub>r</sub>	A	20 - 25
Short-circuit releases			
Non-delayed	$I_i = I_n x \dots$		2 – 18
Delayed >	$I_{sd} = I_r x \dots$		2 – 10
Setting range of earth fault release min.	Ig = Inx		20
Setting range of earth fault release max.	Ig = Inx		25

#### **Technical data**

#### General

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		

Between auxiliary contacts and main contacts		V AC	500	
between the auxiliary contacts		V AC	300	
Mounting position			Vertical and 90° in all directions	With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required	
Degree of protection				
Device			In the operating controls area: IP2	20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle:	IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal:	IP00
Other technical data (sheet catalogue)			Temperature dependency, Deratir	ng
Circuit-breakers  Rated current = rated uninterrupted current	$I_n = I_u$	Α	25	
Rated current = rated uninterrupted current  Rated surge voltage invariability		A	۲.3	
	U <sub>imp</sub>	V	9000	
Main contacts Auxiliary contacts		V	8000 6000	
Rated operational voltage	U <sub>e</sub>	V AC	690	
Overvoltage category/pollution degree	O <sub>e</sub>	V AC	III/3	
Rated insulation voltage	Ui	V	690	
Use in unearthed supply systems	-1	V	≦ 690	
Switching capacity		•	_ 000	
Rated short-circuit making capacity	I <sub>cm</sub>			
240 V	I <sub>cm</sub>	kA	220	
400/415 V	I <sub>cm</sub>	kA	154	
440 V 50/60 Hz	I <sub>cm</sub>	kA	143	
525 V 50/60 Hz	I <sub>cm</sub>	kA	80	
690 V 50/60 H	Ic	kA	40	
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>			
Icu to IEC/EN 60947 test cycle O-t-CO	Icu	kA		
240 V 50/60 Hz	I <sub>cu</sub>	kA	100	
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	70	
440 V 50/60 Hz	I <sub>cu</sub>	kA	65	
525 V 50/60 Hz	I <sub>cu</sub>	kA	36	
690 V 50/60 Hz	I <sub>cu</sub>	kA	20	
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA		
240 V 50/60 Hz	I <sub>cs</sub>	kA	100	
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	70	
440 V 50/60 Hz	I <sub>cs</sub>	kA	65	
525 V 50/60 Hz	I <sub>cs</sub>	kA	36	
690 V 50/60 Hz	I <sub>cs</sub>	kA	6	
Detect about time with start of a course			Maximum back-up fuse, if the exp location exceed the switching cap	ected short-circuit currents at the installation pacity of the circuit-breaker.
Rated short-time withstand current		I. A	10	
t=0.3 s	I <sub>cw</sub>	kA	1.9	
t = 1 s  Utilization category to IEC/EN 60947-2	I <sub>cw</sub>	kA	1.9	
			A	

		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)
Control cables			. (075 05)
	max.	mm	24 x 8
	min.	mm	16 x 5
Direct on the switch			
Screw connection			M8
Bolt terminal and rear-side connection			
Copper busbar (width x thickness)	mm		
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Bolt terminal and rear-side connection			
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
	min.	mm	2 x 9 x 0.8
Box terminal			
Cu strip (number of segments x width x segment thickness)			
Stranded		mm <sup>2</sup>	1 x (25 - 185)
Stranded		2	1 × /75 105)
		mm <sup>-</sup>	****
Solid		mm <sup>2</sup>	1 x 16
Tunnel terminal			
Al circular conductor			2 x (25 - 70)
Stranded		mm <sup>2</sup>	1 x (25 - 185) 2 x (25 - 70)
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (6 - 16)
Direct on the switch			
Bolt terminal and rear-side connection			
1-hole		mm <sup>2</sup>	1 x (25 - 185)
Stranded			
Solid		mm <sup>2</sup>	1 x 16
Tunnel terminal			
		mm	2 x (25 - 70)
Stranded		mm <sup>2</sup>	2 x (6 - 16) 1 x (25 - 185)
Solid		mm <sup>2</sup>	1 x (10 - 16)
Box terminal			
Round copper conductor			Tunnel terminal connection on rear
Optional accessories			Box terminal
Standard equipment			Screw connection
Terminal capacity		1115	
Max. operating frequency  Total break time at short-circuit		ms	< 10
690 V 50/60 Hz	Operations	Ops/h	7500 120
415 V 50/60 Hz	Operations		10000
400 V 50/60 Hz	Operations		10000
	0		40000
AC-1			

# Design verification as per IEC/EN 61439

Lifespan, electrical

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	25
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	0.52
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			

10.2 Strength of materials and parts	
10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


#### **Technical data ETIM 8.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Rated voltage Rated voltage Rated short-circuit breaking capacity Icu at 400 V, 50 Hz  Overload release current setting A  20 - 25  Adjustment range short-term delayed short-circuit release A  A  2 - 10  Adjustment range undelayed short-circuit release A  A  2 - 18  Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally open contact With switched-off indicator With switched-off indicator With switched-off indicator With integrated under voltage release No  Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive integrated Motor drive optional  Na  Complete device with protection unit Motor drive optional  Na  Complete device with protection unit Motor drive optional  Na  Complete device with protection unit Motor drive optional	protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])		
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Overload release current setting A 20-25 Adjustment range short-term delayed short-circuit release A 2-10 Adjustment range undelayed short-circuit release A 2-18 Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as change-over contact With switched-off indicator With switched-off indicator With integrated under voltage release Nounter of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional Motor drive optional Motor drive optional	Rated permanent current lu	Α	25
Overload release current setting Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release A 2 - 18  Yes  Screw connection Built-in device fixed built-in technique Abjustment rail mounting optional Abjustment rail mounting rail release Abjustment release Abjustment rail release Abjustment release Abjustment release Abjustment rail release Abjustment release Abjust	Rated voltage	V	690 - 690
Adjustment range short-term delayed short-circuit release Adjustment range undelayed sont-circuit	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	70
Adjustment range undelayed short-circuit release A 2 - 18 Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Nith switched-off indicator Nith integrated under voltage release Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional  A 2 - 18 Yes Screw connection Suitable for DIN rail (top hat rail) mounting Suitable for DIN rail (top hat rail) mounting Suitable for DIN rail (top hat rail) mounting No No No No No Sociented sevice with protection unit No	Overload release current setting	Α	20 - 25
Integrated earth fault protection Type of electrical connection of main circuit Device construction Built-in device fixed built-in technique Suitable for DIN rail (top hat rail) mounting No DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of of auxiliary contacts as change-over contact No	Adjustment range short-term delayed short-circuit release	Α	2 - 10
Type of electrical connection of main circuit  Device construction  Built-in device fixed built-in technique  No  DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  O  With switched-off indicator  With integrated under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  Screw connection  Built-in device fixed built-in technique  No  O  No  No  Rocker lever  Rocker lever  No  No  Yes	Adjustment range undelayed short-circuit release	Α	2 - 18
Device construction  Built-in device fixed built-in technique  No  No  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  No  With integrated under voltage release  No  No  No  No  No  No  No  No  No  N	Integrated earth fault protection		Yes
Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact O Number of auxiliary contacts as change-over contact O Number of auxiliary contacts as change-over contact O Number of auxiliary contacts as change-over contact O No With switched-off indicator No With integrated under voltage release No No Number of poles Solition of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional No Motor drive optional	Type of electrical connection of main circuit		Screw connection
DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With integrated under voltage release  No  Number of poles  3  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  Yes  Yes  No  No  No  No  No  No  No  No  No  N	Device construction		Built-in device fixed built-in technique
Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With integrated under voltage release  No  No  Number of poles  Solition of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  O  No  No  No  No  No  No  No  No	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With integrated under voltage release  No  Number of poles  Sepsition of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  O  No  No  No  No  Rocker lever  No  No  No  No  No  No  No  No  No  N	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact  With switched-off indicator  No  With integrated under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  No  No  No  No  No  No  Yes	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator  With integrated under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  No  No  No  No  No  No  No  No  Yes	Number of auxiliary contacts as normally open contact		0
With integrated under voltage release  No Number of poles  Solution of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  No	Number of auxiliary contacts as change-over contact		0
Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  3  Front side  Rocker lever  Rocker lever  Yes  No  Yes	With switched-off indicator		No
Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  Front side  Rocker lever  Yes  No  Yes	With integrated under voltage release		No
Type of control element  Complete device with protection unit  Motor drive optional  Rocker lever  Yes  No  Yes	Number of poles		3
Complete device with protection unit  Yes  Motor drive integrated  Motor drive optional  Yes  Yes	Position of connection for main current circuit		Front side
Motor drive integrated No Yes	Type of control element		Rocker lever
Motor drive optional Yes	Complete device with protection unit		Yes
·	Motor drive integrated		No
Degree of protection (IP) IP20	Motor drive optional		Yes
	Degree of protection (IP)		IP20

#### **Characteristics**

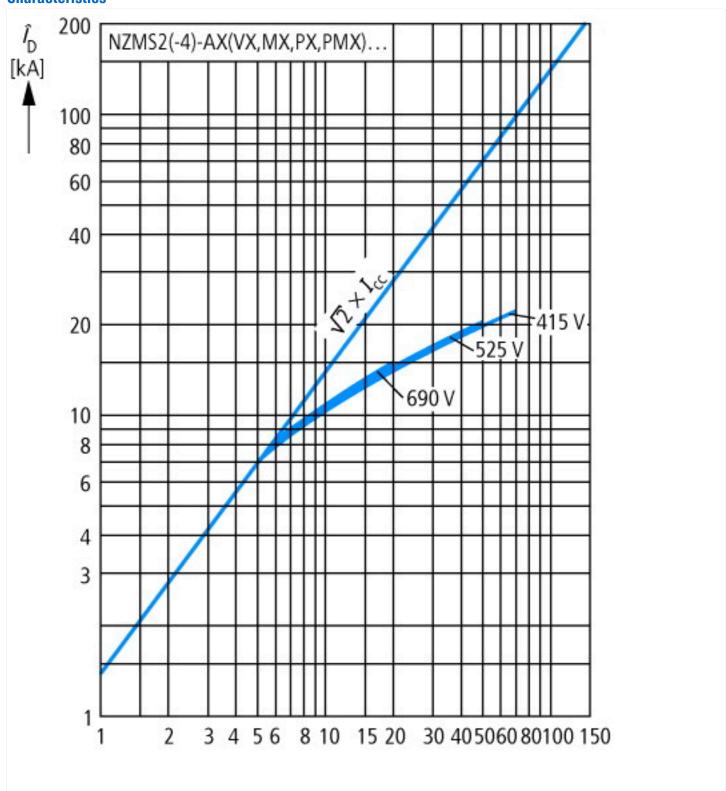


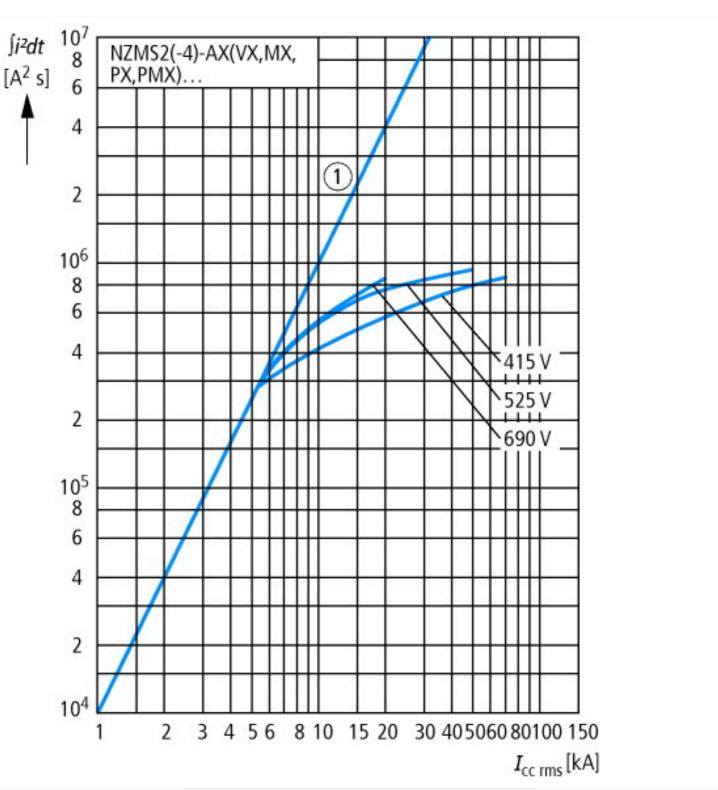

## **Dimensions**

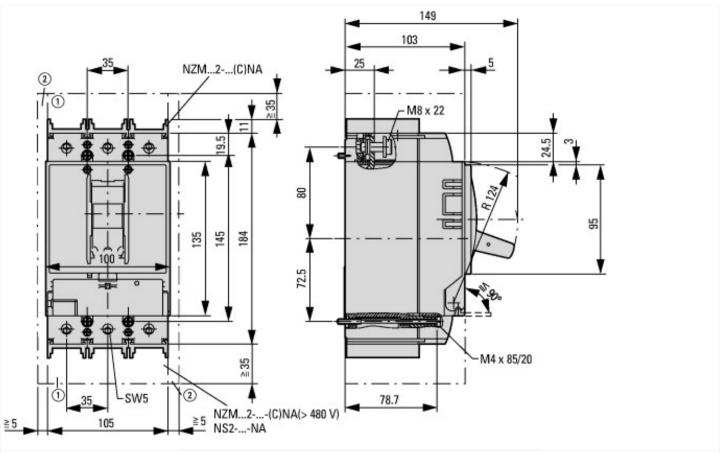

Blow out area, minimum clearance to adjacent parts
 Minimum clearance to adjacent parts

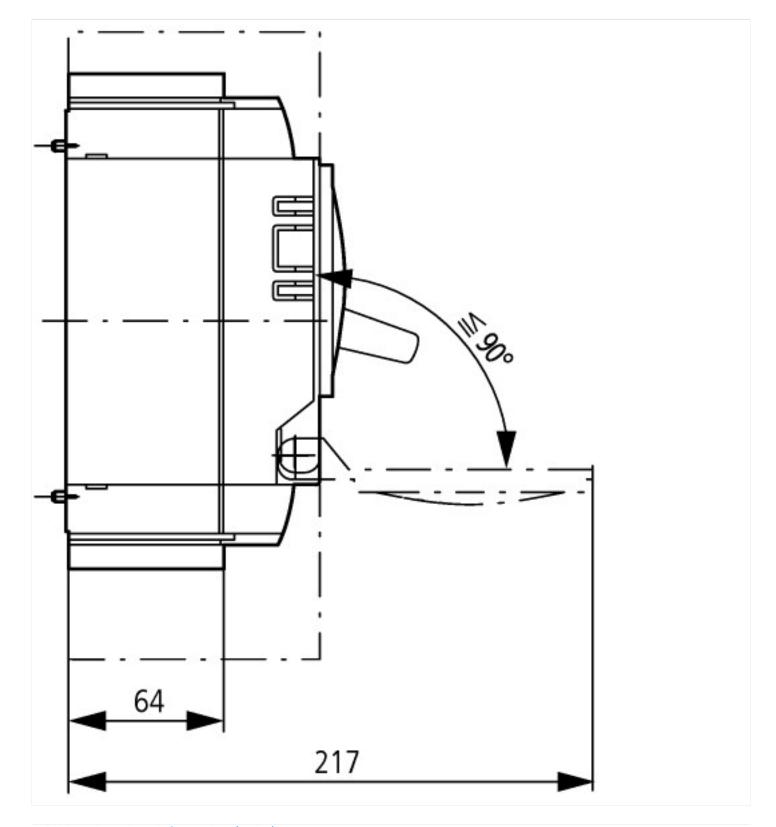

### **Additional product information (links)**

Additional product informa	raditional product information (mixs)			
IL012099ZU NZM2-PXR circuit-breaker, basic device, NZM2-PXR Circuit-Breaker, basic unit				
IL012099ZU NZM2-PXR circuit-breaker, basic device, NZM2-PXR Circuit-Breaker, basic unit	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012099ZU2019_03.pdf			
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172			
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf			