DATASHEET - NZMN2-PX100



NZM2 PXR25 circuit breaker - integrated energy measurement class 1, 100A, 3p, Screw terminal



Part no. Catalog No. EL-Nummer (Norway) NZMN2-PX100 192239

4362735

Similar to illustration

Delivery program

Product range Image: Product range Image: Product range Image: Product range Image: Product range Product range Product range Systems, cable, selectivity and generator protection Batallation type Electronic release Release system Product range NZM2 Description Sistemation and delayed and non-delayed short-circuit protective and delayed and non-delayed and non-delayed short-circuit protective and delayed and non-delayed and non-delayed and non-delayed short-circuit protective and delayed and non-delayed short-circuit protective and delayed and non-delayed short-circuit protective and delayed and non-delayed short-circuit relaxes Specification Specification Specification Specification Specification				
Standard/Approval Ice Ice Installation type Field Field Release system Electronic release Ice Construction size NZM2 Description Verload drotection and delayed and non-delayed short-circuit protective device Class 1 energy measurement, r.m.s. value measurement, and thermal memory' USB interface for configuration and test function with Power Xpert Protection Protectio	Product range			Circuit-breaker
Installation type Installation type Release system Feed Construction size VZM2 Description LSI overload protection and delayed and non-delayed short-circuit protective devices Number of poles VZM2 Standard equipment Image: software endule in equipment supplied. Reted current = rated uninterrupted current Image: software endule in equipment supplied. Overload trip Image: software endule in equipment supplied. Overload trip Image: software endule in equipment supplied. Stort-circuit releases Image: software endule in equipment supplied. Non-delayed Image: software endule in equipment supplied. Non-delayed Image: software endule in equipment supplied. Non-delayed Image: software endule in equipment endule or CAM Non-delayed Image: software endule in equipment supplied. Non-delayed Image: software endule in equipment endule or CAM Non-delayed Image: software endule in equipment endule or CAM Non-delayed Image: software endule in equipment endule endul	Protective function			Systems, cable, selectivity and generator protection
Release systm Image: Systm Image: Systm Image: Systm Construction size Soverload protection and delayed and non-delayed short-circuit protective device error genesurement, r.m.s. value measurement, and "thermal memory" USS interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied. Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optionally communication-capable with internal Modbus RTU module or CAM Optional type of the capable with internal Modbus RTU module or CAM Optional type of the capable with internal Modbus RTU module or CAM Optional type of the capable with internal Modbus RTU module or CAM Optional type of the ca	Standard/Approval			IEC
Construction size NZMZ Description LS overload protection and delayed and non-delayed short-circuit protective device Class 1 energy measurement, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software interface module in equipment supplied. Optionally communication-capable with internal Modulus RTU module or CAM Number of poles 3 pole Standard equipment Server connection Rated current = rated uninterrupted current In = lu A Mathematication In = lu A Overload trip In = lu A Instruction releases In = lu A Short-circuit releases In = lu x A Inon-delayed In = lu x In = lu x Non-delayed In = lu x In = lu x	Installation type			Fixed
Description Iso wertoad protection and delayed and non-delayed short-circuit protective device Cases 1 energy measurement, r.m.s. value measurement, and "harmal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied. Optionally communication-capable with internal Modbus RTU module or CAM Number of poles 3 pole Standard equipment Screw connection Rated current = rated uninterrupted current In = lu A connection Setting range In = lu A connection Overload trip In = lu A connection Short-circuit releases Ir, Rated current releases In = lu A connection Non-delayed Ir, In = lu In = lu In = lu A connection Non-delayed Ir, In = lu	Release system			Electronic release
device Cuss I energy measurement, r.m.s. value measurement, and "hermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied. Optionally communication-capable with internal Modules RTU module or CAMNumber of polesI3 poleStandard equipmentScrew connectionRated current = rated uninterrupted currentIIInterface module interrupted currentIIInterfaceIIOverload tripIIInterface <td< td=""><td>Construction size</td><td></td><td></td><td>NZM2</td></td<>	Construction size			NZM2
Standard equipment Screw connection Rated current = rated uninterrupted current In = Iu A 100 Setting range Image Image Image Image Overload trip Image Image Image Image Short-circuit releases Image Image Image Image Non-delayed Image Image Image Image Image Image Image Image Image	Description			device Class 1 energy measurement, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Interface module in equipment supplied.
Rated current = rated uninterrupted currentIn = IuA100Setting rangeIIOverload tripIIImplement = rated uninterrupted currentImplement = rated uninterrupted currentImplement = rated uninterrupted currentSourload tripImplement = rated uninterrupted currentImplement = rated uninterrupted currentImplement = rated uninterrupted currentImplement = rated uninterrupted currentImplement = rated uninterrupted currentSourload tripImplement = rated uninterrupted currentImplement = ra	Number of poles			3 pole
Rated current = rated uninterrupted current $I_n = I_u$ A100Setting rangeIIIOverload tripIIIIIIIIIIIShort-circuit releasesIII </td <td>Standard equipment</td> <td></td> <td></td> <td>Screw connection</td>	Standard equipment			Screw connection
Setting rangeIIOverload tripIIIIIIIIShort-circuit releasesII	Rated current = rated uninterrupted current			
Overload tripIA $40 \cdot 100$ Short-circuit releasesIIINon-delayedIIIIIIIIIII	Rated current = rated uninterrupted current	$I_n = I_u$	А	100
Ir A 40 - 100 Short-circuit releases Image: Short-circuit releases Image: Non-delayed Image: Image: Short-circuit releases Image: Ima	Setting range			
Short-circuit releases Non-delayed Image: Constraint of the second sec	Overload trip			
Non-delayed I _i = I _n x 2-18	с‡	I _r	А	40 - 100
Delayed I _{sd} = I _r x 2 – 10	Non-delayed	$I_i = I_n \mathbf{x} \dots$		2 – 18
	Delayed	I _{sd} = I _r x		2 – 10

Technical data

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500
between the auxiliary contacts	V AC	300
Mounting position		Vertical and 90° in all directions

Direction of incoming supply Degree of protection Device Enclosures			With XFI earth-fault release: • NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit • NZM1, N1, NZM2, N2: vertical, 90° right/left with vithdrawable unit: • NZM3, N3: vertical, 90° right/left • NZM4, N4: vertical with remote operator: • NZM4, N(S)4: vertical and 90° in all directions as required In the operating controls area: IP20 (basic degree of protection) With door coupling rotary handle: IP66 Tunnel terminal: IP10
Other technical data (sheet catalogue)			Phase isolator and strip terminal: IP00 Weight Temperature dependency, Derating
			Effective power loss
Circuit-breakers Rated current = rated uninterrupted current	$I_n = I_u$	А	100
Rated surge voltage invariability		~	
Main contacts	U _{imp}	V	8000
Auxiliary contacts		v V	6000
Rated operational voltage	Ue	V AC	690
	Ue	VAC	
Overvoltage category/pollution degree		V	III/3 690
Rated insulation voltage	Ui		
Use in unearthed supply systems Switching capacity		V	≦ 690
Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	187
400/415 V	I _{cm}	kA	105
440 V 50/60 Hz		kA	74
	I _{cm}		
525 V 50/60 Hz	I _{cm}	kA	53
690 V 50/60 H	lc	kA	40
Rated short-circuit breaking capacity I _{cn}	I _{cn}		
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA	
240 V 50/60 Hz	I _{cs}	kA	85
400/415 V 50/60 Hz	I _{cs}	kA	50
440 V 50/60 Hz	I _{cs}	kA	35
525 V 50/60 Hz	I _{cs}	kA	25
690 V 50/60 Hz	I _{cs}	kA	5 Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current			
t = 0.3 s	I _{cw}	kA	1.9
t = 1 s	I _{cw}	kA	1.9
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		10000
690 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	< 10

Terminal capacity Standard equipment Screw connection Optional accessories Box terminal Tunnel terminal connection on rear Round copper conductor Box terminal 1 x (10 - 16) 2 x (6 - 16) Solid mm² 1 x (25 - 185) Stranded mm^2 2 x (25 - 70) Tunnel terminal Solid 1 x 16 mm² Stranded 1-hole 1 x (25 - 185) mm² Bolt terminal and rear-side connection Direct on the switch 1 x (10 - 16) 2 x (6 - 16) Solid mm² 1 x (25 - 185) 2 x (25 - 70) Stranded mm² Al circular conductor Tunnel terminal Solid mm² 1 x 16 Stranded Stranded mm² 1 x (25 - 185) Cu strip (number of segments x width x segment thickness) Box terminal 2 x 9 x 0.8 min. mm max. mm 10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8 Bolt terminal and rear-side connection Flat copper strip, with holes 2 x 16 x 0.8 min. mm 10 x 24 x 0.8 Flat copper strip, with holes max. mm Copper busbar (width x thickness) mm Bolt terminal and rear-side connection Screw connection M8 Direct on the switch 16 x 5 min. mm 24 x 8 max. mm Control cables 1 x (0.75 - 2.5) mm^2

Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	А	100
Equipment heat dissipation, current-dependent	P _{vid}	W	8.25
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.

2 x (0.75 - 1.5)


10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


P		
Rated permanent current lu	А	100
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	50
Overload release current setting	А	40 - 100
Adjustment range short-term delayed short-circuit release	А	2 - 10
Adjustment range undelayed short-circuit release	А	2 - 18
Integrated earth fault protection		No
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		3
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		Yes
Degree of protection (IP)		IP20

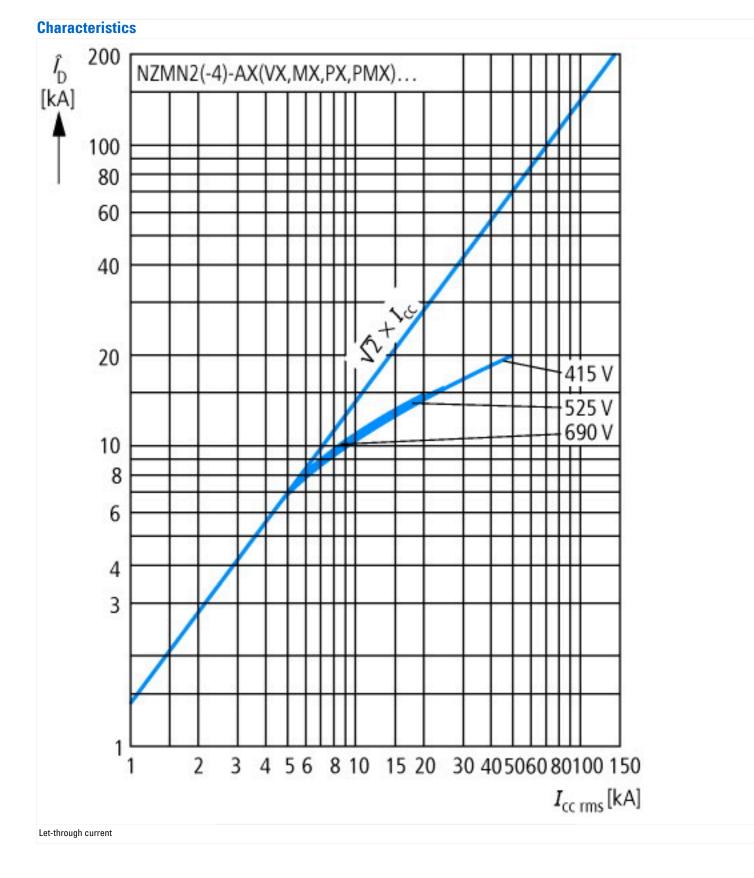

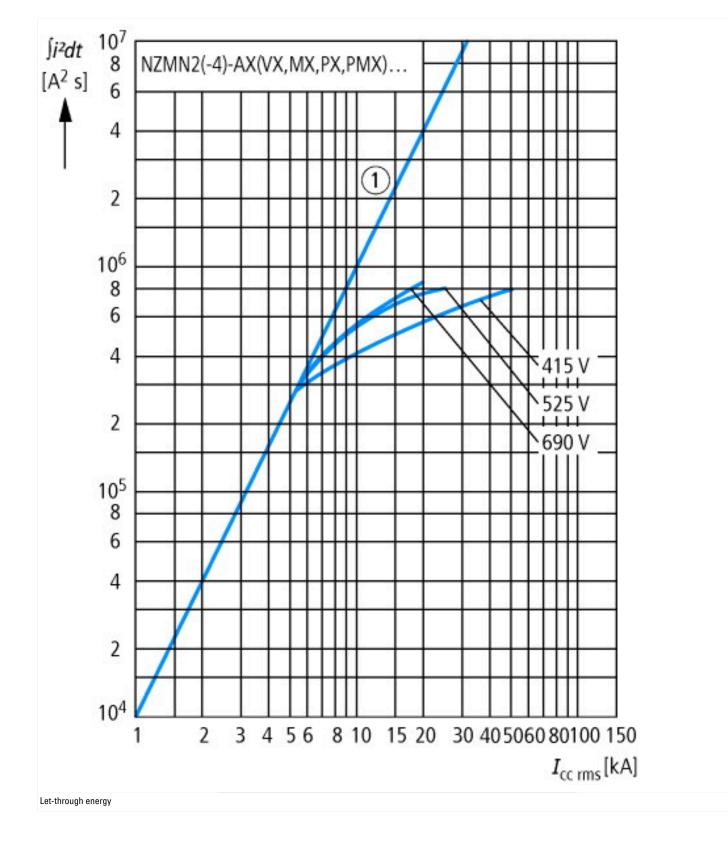

Dimensions



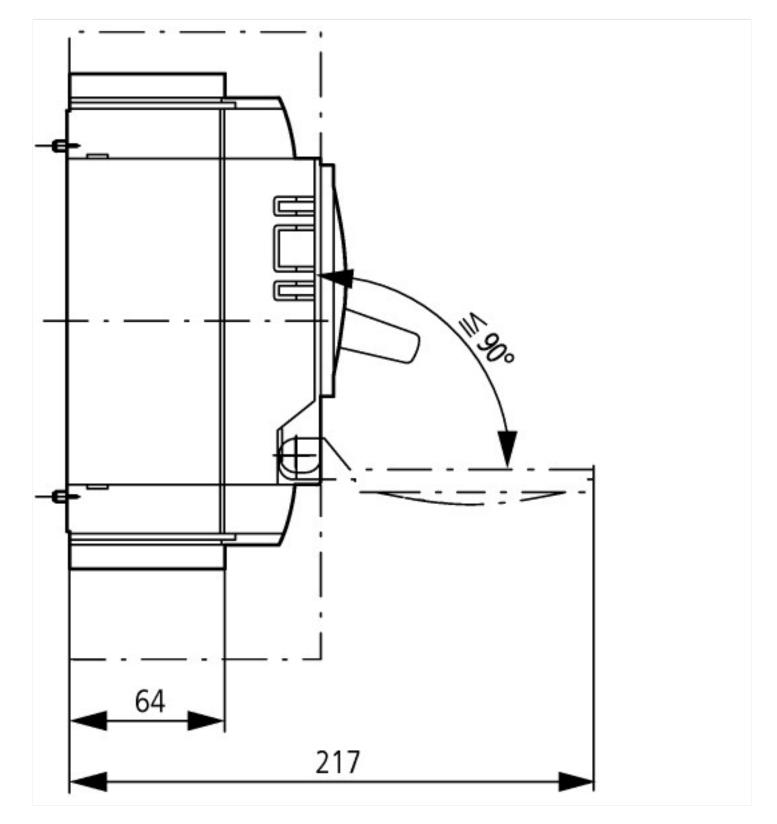

Additional product information (links)

Weight	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.171
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
Effective power loss	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.174
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf