DATASHEET - NZM1-XTVDV



Door coupling rotary handle, lockable on the handle, size 1

Powering Business Worldwide

Catalog No.

NZM1-XTVDV 260172

EL-Nummer (Norway)

Part no.

4315550

Similar to illustration

Delivery program

belivery program	
Product range	Accessories
Accessories	Door coupling rotary handle
Standard/Approval	UL/CSA, IEC
Construction size	NZM1
Description	Door coupling rotary handle for operating the switch through a closed control panel door
Function	Standard, black/grey
Protection class	IP66 UL/CSA Type 4X, Type 12
Locking facility	lockable on the handle on the switch using up to 3 padlocks Modifiable on handle in I position as well With door interlock
Door interlock	Not defeated in the locked OFF and ON positions Can be modified in the unlocked ON position Can be modified such that it can be defeated from the outside using a screwdriver Door can be opened in OFF
Project planning information	External warning plate/designation label can be clipped on. Complete including rotary drive and coupling parts Extension shaft additionally required.
For use with	NZM1(-4), PN1(-4), N(S)1(-4)
lockable	double
Notes	

Circuit-breaker can also be installed in a lying position 90 ° left/right, with the handle still in the same position.

Design verification as per IEC/EN 61439

10.2 Strength of materials and parts 10.2 Strength of materials and parts 10.2.3.1 Verification of thermal stability of enclosures 10.2.3.2 Verification of resistance of insulating materials to normal heat 10.2.3.3 Verification of resistance of insulating materials to normal heat 10.2.3.3 Verification of resistance of insulating materials to abnormal heat 10.2.3 Sverification of resistance of insulating materials to abnormal heat 10.2.4 Resistance to ultra-violet (UV) radiation 10.2.5 Lifting 10.2.5 Lifting 10.2.7 Inscriptions 10.3.1 Degree of protection of ASSEMBLIES 10.3 Degree of protection of ASSEMBLIES 10.4 Clearances and creepage distances 10.5 Protection against electric shock 10.6 Incorporation of switching devices and components 10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Is the panel builder's responsibility. 10.9 Insulation properties 10.9.2 Power-frequency electric strength 1 Is the panel builder's responsibility.	esign verification as per IEC/EN 61439	
10.2.2 Corrosion resistance 10.2.3.1 Verification of thermal stability of enclosures 10.2.3.2 Verification of resistance of insulating materials to normal heat 10.2.3.2 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility.	C/EN 61439 design verification	
10.2.3.1 Verification of thermal stability of enclosures 10.2.3.2 Verification of resistance of insulating materials to normal heat 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility.	10.2 Strength of materials and parts	
10.2.3.2 Verification of resistance of insulating materials to normal heat 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects 10.2.4 Resistance to ultra-violet (UV) radiation 10.2.5 Lifting 10.2.6 Mechanical impact 10.2.7 Inscriptions 10.2.7 Inscriptions 10.3 Degree of protection of ASSEMBLIES 10.4 Clearances and creepage distances 10.5 Protection against electric shock 10.6 Incorporation of switching devices and components 10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Meets the product standard's requirements. Does not apply, since the entire switchgear needs to be evaluated. Meets the product standard's requirements. Does not apply, since the entire switchgear needs to be evaluated. Is the panel builder's responsibility. Is the panel builder's responsibility.	10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
and fire due to internal electric effects 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements. 10.2.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9.1 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.5 Lifting Does not apply, since the entire switchgear needs to be evaluated. 10.2.6 Mechanical impact Does not apply, since the entire switchgear needs to be evaluated. 10.2.7 Inscriptions Meets the product standard's requirements. Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties Is the panel builder's responsibility.		Meets the product standard's requirements.
10.2.6 Mechanical impact 10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock 10.6 Incorporation of switching devices and components 10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Does not apply, since the entire switchgear needs to be evaluated. Is the panel builder's responsibility. Is the panel builder's responsibility.	10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.7 Inscriptions Meets the product standard's requirements. 10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire switchgear needs to be evaluated. 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.3 Degree of protection of ASSEMBLIES 10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock 10.6 Incorporation of switching devices and components 10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Does not apply, since the entire switchgear needs to be evaluated. Is the panel builder's responsibility. Is the panel builder's responsibility.	10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances Meets the product standard's requirements. 10.5 Protection against electric shock Does not apply, since the entire switchgear needs to be evaluated. 10.6 Incorporation of switching devices and components Does not apply, since the entire switchgear needs to be evaluated. 10.7 Internal electrical circuits and connections Is the panel builder's responsibility. 10.8 Connections for external conductors Is the panel builder's responsibility. 10.9 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	10.2.7 Inscriptions	Meets the product standard's requirements.
10.5 Protection against electric shock 10.6 Incorporation of switching devices and components 10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Does not apply, since the entire switchgear needs to be evaluated. Is the panel builder's responsibility. Is the panel builder's responsibility. Is the panel builder's responsibility.	10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components 10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Does not apply, since the entire switchgear needs to be evaluated. Is the panel builder's responsibility. Is the panel builder's responsibility.	10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.7 Internal electrical circuits and connections 10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. Is the panel builder's responsibility. Is the panel builder's responsibility.	10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.8 Connections for external conductors 10.9 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility. Is the panel builder's responsibility.	10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.9 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.9.2 Power-frequency electric strength Is the panel builder's responsibility.	10.8 Connections for external conductors	Is the panel builder's responsibility.
	10.9 Insulation properties	
10.9.3 Impulse withstand voltage Is the panel builder's responsibility.	10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
	10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility.	10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise The panel builder is responsible for the temperature rise calculation. Eaton provide heat dissipation data for the devices.	10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear observed.	10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.


10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Handle for power circuit breaker (EC000229)			
Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Handle for switch devices (ecl@ss10.0.1-27-37-04-14 [AKF012014])			
Lockable	Yes		
Colour	Black		
Suitable for emergency stop	No		
With extension shaft	No		
Suitable for power circuit breaker	Yes		
Suitable for switch disconnector	Yes		

Approvals

Product Standards	UL489; CSA-C22.2 No. 5-09; IEC60947, CE marking
UL File No.	E140305
UL Category Control No.	DIHS
CSA File No.	022086
CSA Class No.	1437-01
North America Certification	UL listed, CSA certified
Degree of Protection	IEC: IP66, UL/CSA Type 4X, 12

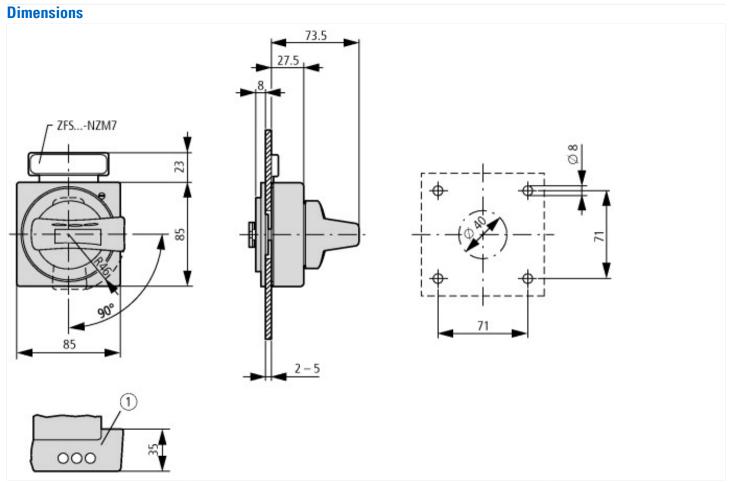

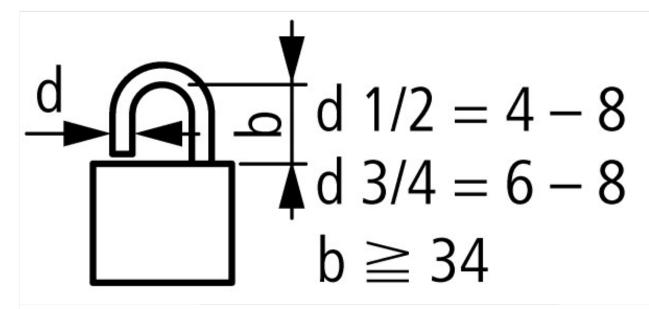

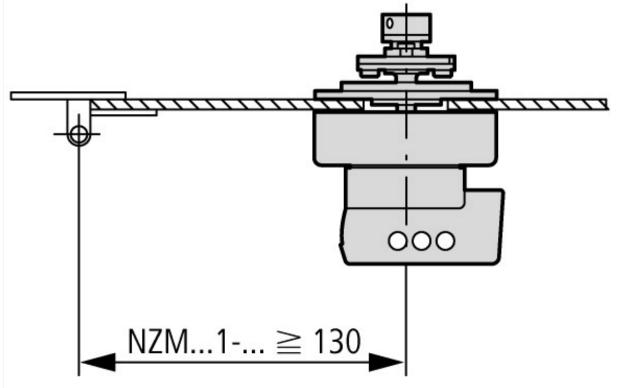

Minimum door coupling rotary handle clearance from door pivot point