## **DATASHEET - NZMC2-4-A200**



Circuit-breaker, 4p, 200A

Part no. NZMC2-4-A200 Catalog No. 271435



Similar to illustration

| Delivery program                            |                          |    |   |
|---|--------------------------|----|---|
| Product range                               |                          |    | Circuit-breaker   |
| Protective function                         |                          |    | System and cable protection   |
| Standard/Approval                           |                          |    | IEC   |
| nstallation type                            |                          |    | Fixed   |
| Release system                              |                          |    | Thermomagnetic release  |
| Construction size                           |                          |    | NZM2  |
| Description                                 |                          |    | Set value in neutral conductor is synchronous with set value Ir of main pole. |
| Number of poles                             |                          |    | 4 pole  |
| Standard equipment                          |                          |    | Screw connection  |
| Switching capacity                          |                          |    |   |
| 400/415 V 50 Hz                             | I <sub>cu</sub>          | kA | 36  |
| Rated current = rated uninterrupted current |                          |    |   |
| Rated current = rated uninterrupted current | $I_n = I_u$              | Α  | 200   |
| Neutral conductor                           | % of phase conductor     | %  | 100   |
| Setting range                               |                          |    |   |
| Overload trip                               |                          |    |   |
| 中   | I <sub>r</sub>           | Α  | 160 - 200   |
| Main pole                                   | l <sub>r</sub>           | A  | 160 - 200   |
| Short-circuit releases                      |                          |    |   |
| Non-delayed                                 | $I_i = I_n \times \dots$ |    | 6 - 10  |
| Short-circuit releases                      | I <sub>rm</sub>          | A  | 1200 - 2000   |

### **Technical data**

General

| General   |   |      |  |
|---|---|------|--|
| Standards   |   |      | IEC/EN 60947   |
| Protection against direct contact   |   |      | Finger and back of hand proof to VDE 0106 Part 100                             |
| Climatic proofing   |   |      | Damp heat, constant, to IEC 60068-2-78<br>Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature   |   |      |  |
| Ambient temperature, storage  | 0 | C.   | - 40 - + 70  |
| Operation   | 0 | C.   | -25 - +70  |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 3    | 20 (half-sinusoidal shock 20 ms)   |
| Safe isolation to EN 61140  |   |      |  |
| Between auxiliary contacts and main contacts  | V | / AC | 500  |
| between the auxiliary contacts  | V | / AC | 300  |

| Mounting position   |                  |      | Vertical and 90° in all directions  With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
|---|------------------|------|---|
| Direction of incoming supply  |                  |      | as required   |
| Degree of protection  |                  |      |   |
| Device  |                  |      | In the operating controls area: IP20 (basic degree of protection)   |
| Enclosures  |                  |      | With insulating surround: IP40 With door coupling rotary handle: IP66   |
| Terminations  |                  |      | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00   |
| Other technical data (sheet catalogue)                                      |                  |      | Temperature dependency, Derating  |
| Circuit-breakers  Rated current = rated uninterrupted current               | $I_n = I_u$      | А    | 200   |
| ·   |                  | ^    | 200   |
| Rated surge voltage invariability   | U <sub>imp</sub> | V    | 2000  |
| Main contacts   |                  | V    | 8000  |
| Auxiliary contacts  |                  | V    | 6000  |
| Rated operational voltage   | U <sub>e</sub>   | V AC | 690   |
| Overvoltage category/pollution degree                                       |                  | .,   | III/3   |
| Rated insulation voltage  | Ui               | V    | 690   |
| Use in unearthed supply systems   |                  | V    | ≦ 690   |
| Switching capacity Rated short-circuit making capacity                      | I <sub>cm</sub>  |      |   |
| 240 V   | I <sub>cm</sub>  | kA   | 121   |
| 400/415 V   |                  | kA   | 76  |
|   | I <sub>cm</sub>  |      |   |
| 440 V 50/60 Hz  | I <sub>cm</sub>  | kA   | 63  |
| 525 V 50/60 Hz  | I <sub>cm</sub>  | kA   | 24  |
| 690 V 50/60 H   | Ic               | kA   | 14  |
| Rated short-circuit breaking capacity I <sub>cn</sub>                       | I <sub>cn</sub>  |      |   |
| Icu to IEC/EN 60947 test cycle 0-t-C0                                       | lcu              | kA   |   |
| 240 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 55  |
| 400/415 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 36  |
| 440 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 30  |
| 525 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 12  |
| 690 V 50/60 Hz  | I <sub>cu</sub>  | kA   | 8   |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0                                  | lcs              | kA   |   |
| 240 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 55  |
| 400/415 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 36  |
| 440 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 22.5  |
| 525 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 6   |
| 690 V 50/60 Hz  | I <sub>cs</sub>  | kA   | 4   |
|   |                  |      | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.   |
| Utilization category to IEC/EN 60947-2                                      |                  |      | A   |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations       |      | 20000   |
| Lifespan, electrical  |                  |      |   |
| AC-1  |                  |      |   |
| 400 V 50/60 Hz  | Operations       |      | 10000   |
| 415 V 50/60 Hz  | Operations       |      | 7500  |
| 690 V 50/60 Hz  | Operations       |      | 5000  |

| Max. operating frequency                                  |      | Ops/h           | 120   |
|---|------|-----------------|---|
| Total break time at short-circuit                         |      | ms              | < 10  |
| Terminal capacity   |      |                 |   |
| Standard equipment  |      |                 | Screw connection  |
| Optional accessories                                      |      |                 | Box terminal Tunnel terminal connection on rear         |
| Round copper conductor                                    |      |                 |   |
| Box terminal  |      |                 |   |
| Solid   |      | mm <sup>2</sup> | 1 x (10 - 16)<br>2 x (6 - 16)                           |
| Stranded  |      | mm <sup>2</sup> | 1 x (25 - 185)<br>2 x (25 - 70)                         |
| Tunnel terminal   |      |                 |   |
| Solid   |      | mm <sup>2</sup> | 1 x 16  |
| Stranded  |      |                 |   |
| 1-hole  |      | mm <sup>2</sup> | 1 x (25 - 185)  |
| Bolt terminal and rear-side connection                    |      |                 |   |
| Direct on the switch                                      |      |                 |   |
| Solid   |      | mm <sup>2</sup> | 1 x (10 - 16)<br>2 x (6 - 16)                           |
| Stranded  |      | mm <sup>2</sup> | 1 x (25 - 185)<br>2 x (25 - 70)                         |
| Al circular conductor                                     |      |                 |   |
| Tunnel terminal   |      |                 |   |
| Solid   |      | mm <sup>2</sup> | 1 x 16  |
| Stranded  |      |                 |   |
| Stranded  |      | mm <sup>2</sup> | 1 x (25 - 185)  |
| Cu strip (number of segments x width x segment thickness) |      |                 |   |
| Box terminal  |      |                 |   |
|   | min. | mm              | 2 x 9 x 0.8   |
|   | max. | mm              | 10 x 16 x 0.8<br>(2x) 8 x 15.5 x 0,8                    |
| Bolt terminal and rear-side connection                    |      |                 |   |
| Flat copper strip, with holes                             | min. | mm              | 2 x 16 x 0.8  |
| Flat copper strip, with holes                             | max. | mm              | 10 x 24 x 0.8   |
| Copper busbar (width x thickness)                         | mm   |                 |   |
| Bolt terminal and rear-side connection                    |      |                 |   |
| Screw connection  |      |                 | M8  |
| Direct on the switch                                      |      |                 |   |
|   | min. | mm              | 16 x 5  |
|   | max. | mm              | 24 x 8  |
| Control cables  |      |                 |   |
|   |      | mm <sup>2</sup> | 1 x (0.75 - 2.5)   2 x (0.75 - 1.5)<br>2 x (0.75 - 1.5) |

# Design verification as per IEC/EN 61439

| Technical data for design verification                                     |           |    |  |
|--|-----------|----|--|
| Rated operational current for specified heat dissipation                   | In        | Α  | 200  |
| Equipment heat dissipation, current-dependent                              | $P_{vid}$ | W  | 48   |
| Operating ambient temperature min.   |           | °C | -25  |
| Operating ambient temperature max.   |           | °C | 70   |
| IEC/EN 61439 design verification   |           |    |  |
| 10.2 Strength of materials and parts                                       |           |    |  |
| 10.2.2 Corrosion resistance  |           |    | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures                   |           |    | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat |           |    | Meets the product standard's requirements. |


| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | Meets the product standard's requirements.   |
|--|--|
| 10.2.4 Resistance to ultra-violet (UV) radiation   | Meets the product standard's requirements.   |
| 10.2.5 Lifting   | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.6 Mechanical impact   | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.7 Inscriptions  | Meets the product standard's requirements.   |
| 10.3 Degree of protection of ASSEMBLIES  | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.4 Clearances and creepage distances   | Meets the product standard's requirements.   |
| 10.5 Protection against electric shock   | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.6 Incorporation of switching devices and components   | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.7 Internal electrical circuits and connections  | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors   | Is the panel builder's responsibility.   |
| 10.9 Insulation properties   |  |
| 10.9.2 Power-frequency electric strength   | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage   | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material   | Is the panel builder's responsibility.   |
| 10.10 Temperature rise   | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating   | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility  | Is the panel builder's responsibility. The specifications for the switchgear must lobserved.                                     |
| 10.13 Mechanical function  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |


#### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


| Rated voltage V V 690 - 690 Rated short-circuit breaking capacity Icu at 400 V, 50 Hz   | protection (eci@ss10.0.1-27-37-04-09 [AJZ/10013])         |    |   |  |
|---|---|----|---|--|
| Rated short-circuit breaking capacity Icu at 400 V, 50 Hz  A 160 - 200  Adjustment range short-term delayed short-circuit release A 0 - 0  Adjustment range undelayed short-circuit release A 1200 - 2000  Adjustment range undelayed short-circuit release A 1200 - 2000  Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With switched-off indicator With under voltage release Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive integrated Motor drive optional | Rated permanent current lu                                | А  |   | 200                                      |
| Overload release current setting A 160 - 200 Adjustment range short-term delayed short-circuit release A 0 - 0 Adjustment range undelayed short-circuit release A 1200 - 2000 Integrated earth fault protection No Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as change-over contact With switched-off indicator With switched-off indicator With under voltage release No Number of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional   | Rated voltage   | V  | , | 690 - 690                                |
| Adjustment range short-term delayed short-circuit release A 1200 - 2000 Integrated earth fault protection No Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally open contact With switched-off indicator With switched-off indicator With under voltage release Nounder of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional Motor drive optional  | Rated short-circuit breaking capacity Icu at 400 V, 50 Hz | k/ | Α | 36                                       |
| Adjustment range undelayed short-circuit release A 1200 - 2000 Integrated earth fault protection No Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Nith switched-off indicator No With under voltage release No No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional Motor drive optional   | Overload release current setting                          | А  | ١ | 160 - 200                                |
| Integrated earth fault protection Type of electrical connection of main circuit  Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  No  No  Number of auxiliary contacts as normally closed contact  No  Number of auxiliary contacts as normally open contact  No  Number of auxiliary contacts as change-over contact  No  No  With switched-off indicator  With switched-off indicator  With under voltage release  No  No  No  No  No  No  No  No  No  N  | Adjustment range short-term delayed short-circuit release | Α  |   | 0 - 0                                    |
| Type of electrical connection of main circuit  Device construction  Built-in device fixed built-in technique  No  DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Ves  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  With switched-off indicator  With switched-off indicator  With under voltage release  No  Number of poles  4  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  Screw connection  Built-in device fixed built-in technique  No  No  Res  Rocker lever  No  No  With under voltage release  No  No  Rocker lever  | Adjustment range undelayed short-circuit release          | А  |   | 1200 - 2000                              |
| Device construction  Suitable for DIN rail (top hat rail) mounting  DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  No  With under voltage release  No  No  No  No  No  No  No  Type of control element  Complete device with protection unit  Motor drive integrated  No  Motor drive optional  Built-in device fixed built-in technique  No  Res  No  No  No  No  No  No  No  No  No  N   | Integrated earth fault protection                         |    |   | No                                       |
| Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With under voltage release  No  No  Number of poles  Position of connection for main current circuit  Trope of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  No  Motor drive optional   | Type of electrical connection of main circuit             |    |   | Screw connection                         |
| DIN rail (top hat rail) mounting optional  Number of auxiliary contacts as normally closed contact  0  Number of auxiliary contacts as normally open contact  0  Number of auxiliary contacts as change-over contact  0  With switched-off indicator  With under voltage release  No  Number of poles  4  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  Yes  Yes  Motor drive optional  | Device construction                                       |    |   | Built-in device fixed built-in technique |
| Number of auxiliary contacts as normally closed contact  Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  Number of auxiliary contacts as change-over contact  No  With switched-off indicator  With under voltage release  No  Number of poles  4  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  Motor drive optional  O  No  No  No  No  No  No  No  No  No   | Suitable for DIN rail (top hat rail) mounting             |    |   | No                                       |
| Number of auxiliary contacts as normally open contact  Number of auxiliary contacts as change-over contact  No With switched-off indicator  No With under voltage release  No Number of poles  4 Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  Rocker lever  No  Yes   | DIN rail (top hat rail) mounting optional                 |    |   | Yes                                      |
| Number of auxiliary contacts as change-over contact  With switched-off indicator  No  With under voltage release  No  Number of poles  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  O  No  No  No  No  No  Yes   | Number of auxiliary contacts as normally closed contact   |    |   | 0  |
| With switched-off indicator  With under voltage release  No  Number of poles  4  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  No  No  No  No  No  Yes  | Number of auxiliary contacts as normally open contact     |    |   | 0  |
| With under voltage release  No  Number of poles  4  Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  No  No  Yes   | Number of auxiliary contacts as change-over contact       |    |   | 0  |
| Number of poles  4 Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive integrated  Motor drive optional  4 Rocker lever  Rocker lever  No  Yes  | With switched-off indicator                               |    |   | No                                       |
| Position of connection for main current circuit  Type of control element  Complete device with protection unit  Motor drive optional  Front side  Rocker lever  Yes  Yes  Yes   | With under voltage release                                |    |   | No                                       |
| Type of control element  Complete device with protection unit  Motor drive optional  Rocker lever  Yes  No  Yes   | Number of poles   |    |   | 4  |
| Complete device with protection unit  Yes  Motor drive integrated  Motor drive optional  Yes  | Position of connection for main current circuit           |    |   | Front side                               |
| Motor drive integrated No Yes   | Type of control element                                   |    |   | Rocker lever                             |
| Motor drive optional Yes  | Complete device with protection unit                      |    |   | Yes                                      |
| ·   | Motor drive integrated                                    |    |   | No                                       |
| Degree of protection (IP)   | Motor drive optional                                      |    |   | Yes                                      |
|   | Degree of protection (IP)                                 |    |   | IP20                                     |

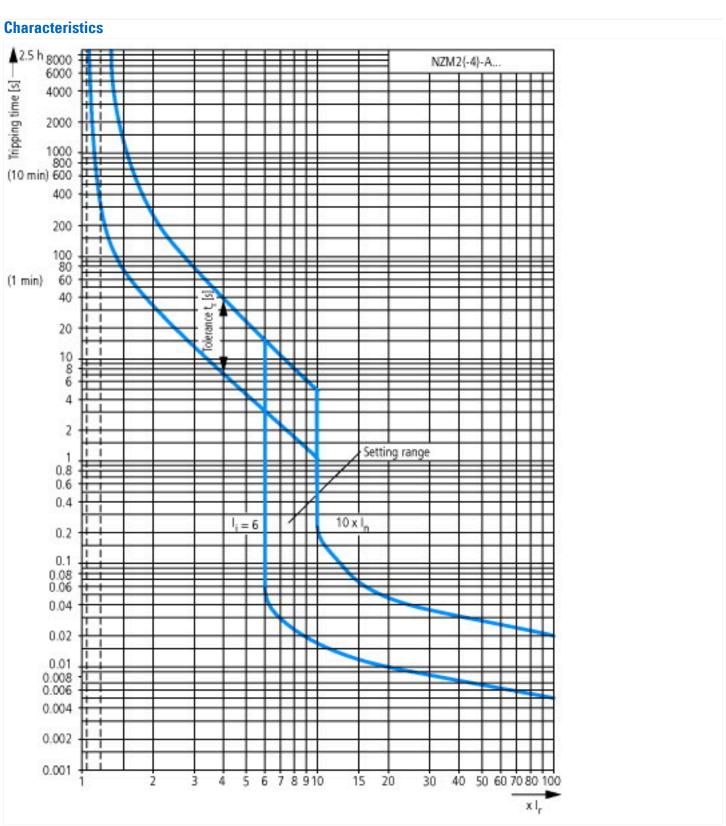


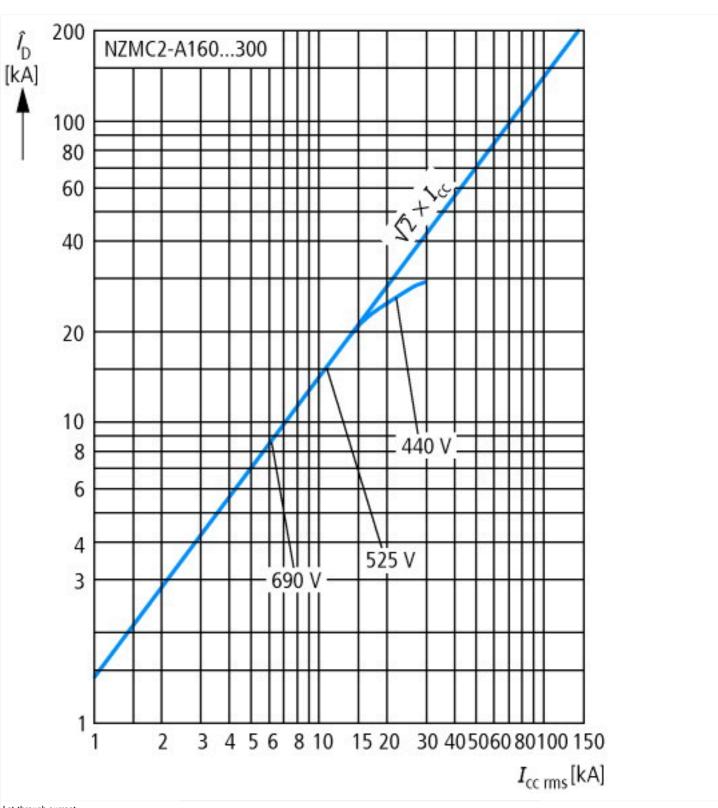

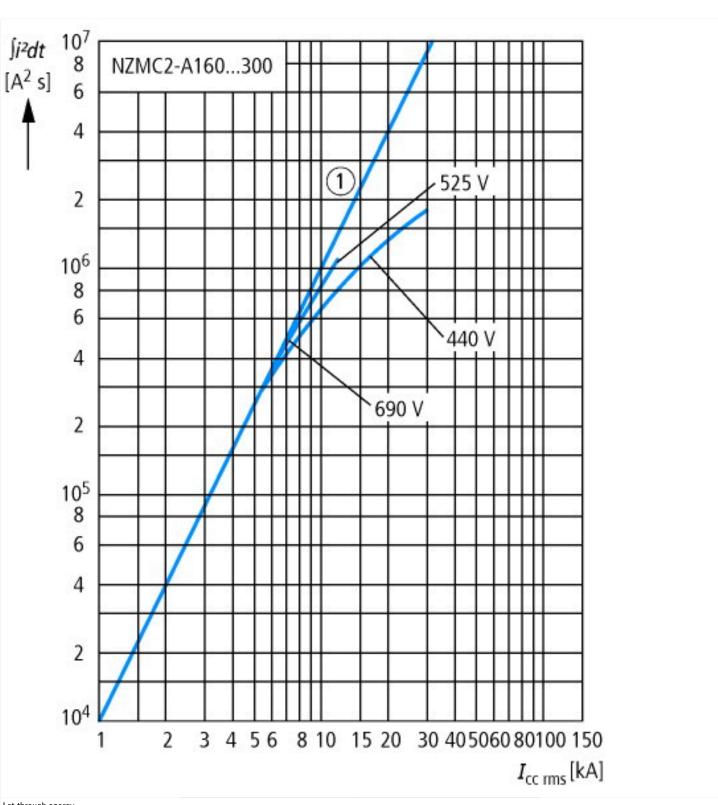

# **Dimensions**

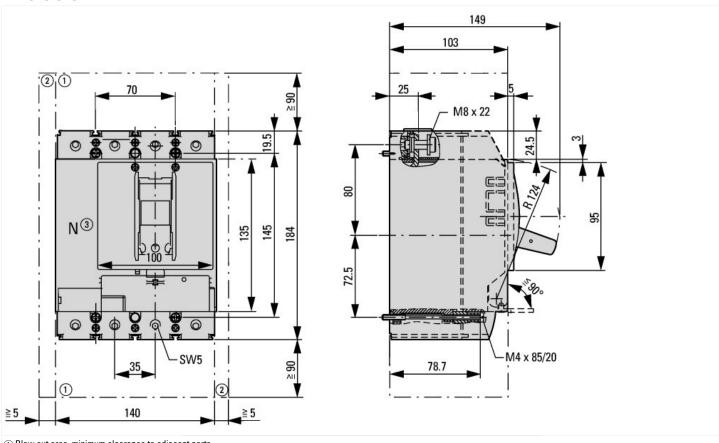

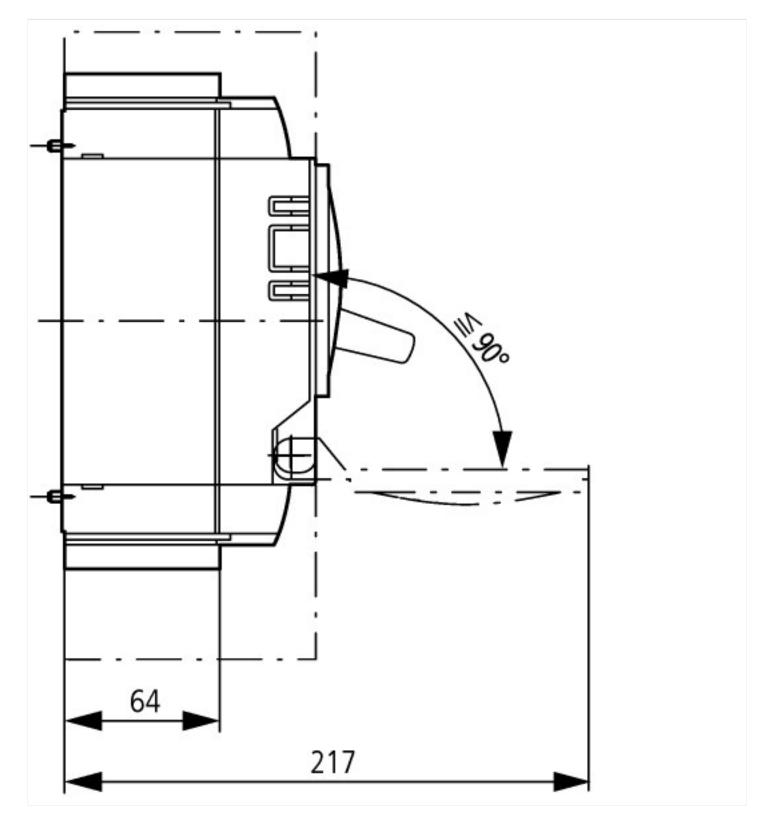

## **Additional product information (links)**

| Temperature dependency, Derating                      | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172   |
|---|--|
| CurveSelect characteristics program                   | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm |
| additional technical information for NZM power switch | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf  |